

Semi-Annual Social Safeguard Monitoring Report

Loan Number : 3521-IND & 8325-IND

Reporting Period : July- December, 2020

Solar Transmission Sector Project

Prepared by : ESMD, CORPORATE CENTRE, POWERGRID

Implementing Agency : POWERGRID

Executing Agency : POWERGRID

Date : 05.03.2021

ABBREVIATIONS

ADB	–	Asian Development Bank
CEA	–	Central Electricity Authority
CPTD	–	Compensation Plan for Temporary Damages
CSS	–	Country Safeguard System
CTU	–	Central Transmission Utility
DFO	–	Divisional Forest Officer
EAMP	–	Environmental Assessment Management Plan
ESPP	–	Environment and Social Policy & Procedures
ESMD	–	Environment & Social Management Department
EMP	–	Environmental Management Plan
GHGs	–	Green House Gases
GRM	–	Grievances Redressal Mechanism
GRC	–	Grievance Redressal Committee
HVDC	–	High Voltage Direct Current
IEAR	–	Initial Environmental Assessment Report
ISTS	–	Inter State Transmission Scheme
Km	–	Kilometers
MoEFCC	–	Ministry of Environment, Forest and Climate Change
PAL	–	POWERGRID Academy of Leadership
PAPs	–	Project Affected Persons
POWERGRID	–	Power Grid Corporation of India Ltd.
PMU	–	Project Management Unit
RAP	–	Resettlement Action Plan
RE	–	Renewable Energy
RoW	–	Right of Way
S/s	–	Substation
SAMP	–	Social Assessment Management Plan
SPS	–	Safeguard Policy Statement of ADB
TPDP	–	Tribal People Development Plan
UMSPP	–	Ultra Mega Solar Power Parks
USD	–	United States Dollar

TABLE OF CONTENTS

Section		Description		Page No.
		Executive Summary		4-5
Section 1	:	Introduction	-	6
1.1	:	Overall Project Description	-	7
1.2	:	Project Objectives	-	8
1.3	:	Safeguard Category	-	8
1.4	:	Social Performance Indicator	-	8
1.5	:	Overall Project Progress, Agreed Milestones and Completion Schedules	-	8
Section 2	:	Compliance Status with Major Loan Covenants	-	10
Section 3	:	Status of Land & Social Compliances	-	13
Section 4	:	Approach and Methodology engaged for Social Monitoring of the Project	-	36
Section 5	:	Details of Grievance Redress Committee and Complaint Received and action taken	-	36
Section 6	:	Conclusion	-	38

LIST OF TABLE

S. No.	Description	Pages
Table 1	Details of Substation Land	13
Table 2	Details of Crop & Tree Compensation	13
Table -3	Details of Land Compensation as per MoP Guidelines	14
Table- 4	Details of Land Compensation paid during reporting period (July-December, 2020)	15
Table- 5	Details of Land Compensation up to December, 2020	15
Table – E1	Environment Management Plan	18
Table- 6	Details of Court Cases and Complaints as of December, 2020	37

LIST OF FIGURES

S. No.	Description	Pages
Figure 1	Tree / Crop Compensation Process	17

Enclosures:

Annexure- 1: Status of Action Plan for Safeguards under CSS	40
Annexure- 2: Sample Copy of Compensation Process	42
Annexure -3: E & S Training Programme.....	45
Annexure-4: Construction of Community Centre at Madikeri under CSR.....	46

Executive Summary

POWERGRID, the Central Transmission Utility (CTU) of the country has been implementing various Inter State Transmission System (ISTS) in 7 States associated with 9 Ultra Mega Solar Power Parks on compressed time schedule basis. The Solar Transmission Sector Project ("The Project") comprising of different transmission systems associated with Solar Power Parks at Bhadla (Rajasthan), Banaskantha (Gujarat), Tumkur (Karnataka) and refurbishment work of HVDC Rihand-Dadri Project being implemented with financial assistance of USD 225 million from ADB under loan no. 3521-IND & 8325-IND. The said loan was signed on 5 April, 2017 and became effective from 9 May, 2017 with loan closing date of 31 May, 2022. The objective is to improve import capability of Northern, Southern & Western regions through transmitting harnessed solar power, which is another sustainable alternative, renewable and non-polluting form of energy.

This Project is being implemented and monitored in line with the POWERGRID's Environmental and Social Policy & Procedures (ESPP) and the Action Plan for Safeguards prepared for the use of CSS so as to ensure that ESPP achieve and maintain full equivalence with ADB's SPS, 2009. The Project is categorized as "B" and "C" for Involuntary Resettlement & Indigenous People aspects respectively as per ADB's SPS.

The Project components include construction of about 639.61 km of new 765kV/400 kV D/c transmission lines (in 5 segments) and associated substations (1 new 765kV/400/220 kV substations and extension works at 8 substations). The project components are spread across 4 different States i.e. Rajasthan, Gujarat, Karnataka and Uttar Pradesh. For construction of new substation at Bhadla, encroachment free govt. land measuring 130.91 acres was secured from State Govt. through transfer. However, required lands for proposed extension at Bikaner, Tumkur (Pavagada), Tumkur (Vasantnarsapur) & Mysore substation are already available in respective existing substations of POWERGRID and no fresh land was secured for this purpose. Since no involuntary acquisition of land and no Project Affected Persons (PAPs) involved issues related to Rehabilitation & Resettlement/ Rehabilitation Action Plan not envisaged in the instant project.

As per law of land, no land is acquired for transmission line but damages are compensated as per provisions of Electricity Act, 2003 and Indian Telegraph Act, 1885. POWERGRID is taking all possible efforts to avoid damage to standing crops and trees during construction of transmission lines, However, in case of damages, compensation is being paid to affected land owners/farmers for damage to standing crops/tree after due assessment of revenue authority/competent authority. During reporting period of July-December 2020, compensation to the tune of Rs 25.27 million has been paid towards crop & tree damages with notices issued to a total of 978 APs for land area of 30.474 ha. As of December, 2020, a total of 11,215 persons were issued notices for 1311.514 ha. of

crop area/tree damaged for which total compensation of Rs. 421.54 million paid to affected farmers/land owners (Rs. 49.024 million during foundation, Rs. 44.776 million during erection and Rs.327.74 million during stringing). Further, POWERGRID has already started paying land compensation for tower footing and RoW Corridor in compliance to Ministry of Power guidelines on RoW compensation dated 15th October, 2015 and subsequent govt. order/notification issued by Govt of Gujarat and Tamilnadu for its implementation. Accordingly, till December, 2020, an amount of Rs. 1599.317 million has been paid towards land compensation for tower base and RoW corridor in Karnataka and Gujarat.

The project specific mitigation measures in enlisted in EMP, which is also part of contract documents are being applied appropriately in different stage of project and regularly monitored for proper implementation. As regard COVID-19 pandemic, all protocols of Govt. of India and State Govt in respect of COVID-19 are being mandatorily followed. Besides, POWERGRID has been implementing COVID-19 specific guidelines prepared by Corporate Safety Cell (already shared in May'20) in all establishments including construction sites where work resumed after lockdown (**Appendix-1**).

The two-tier grievance redress mechanism has been addressing/resolving the concerns and grievances of the complainant effectively. All concerns/grievances of affected persons/public including minor nature are also recorded and regularly tracked for early resolution within stipulated timeframe. As part of tree and crop compensation process, POWERGRID officials also listen to the complaints of affected farmers and takes necessary action to mitigate the concerns of the affected persons. As of December 2020, 15 cases out of total 18 complaints remains open/are being negotiated.

POWERGRID endeavors to minimize the social impacts started right from the selection of land for the proposed substations by completely avoiding the socially sensitive areas. Besides, all efforts have been made to minimize the social impacts associated with the project. POWERGRID is also undertaking various need based Community Development Works under its Corporate Social Responsibility (CSR) activities in and around its areas of operations for socio-economic and integral development of areas and communities at large. The instant investment for infrastructure development shall have a positive impact on several socio-economic indicators in the nearby community in long run and will ward off any temporary offset faced due to said project.

SECTION 1: INTRODUCTION

Power Grid Corporation of India Ltd. (POWERGRID), the Central Transmission Utility (CTU) of the country, is engaged in power transmission with the mandate for planning, co-ordination, supervision and control over complete Inter-State transmission system. It has been contributing significantly towards development of Indian power sector by undertaking coordinated development of power transmission network along with effective and transparent operation of regional grids and through continuous innovations in technical & managerial fields.

Government of India has taken up the initiative for development of Ultra Mega Solar Power Parks (UMSPP) in various parts of the country. Keeping in view short gestation period of solar generation project and time required for development of evacuation system, it is proposed that the transmission scheme may be implemented in different phases commensurate to the power transfer requirement. MoP vide letter dated 08.01.15 & 04.08.15 intimated POWERGRID for taking up of transmission system for evacuation of power from 9 solar generating parks being set up in 7 States along with pooling stations as ISTS Scheme, including subject Tumkur (Pavagada) UMSPP on compressed time schedule basis.

As part of above initiative, an ultra-mega solar power park of 2000 MW capacity is being developed by M/s Karnataka Solar Power Development Corporation Ltd. (KSPDCL) (JVC of SECI & KREDL) at Pavagada in Tumkur district of Karnataka in two phases with 1000MW in each phase. A Ultra-Mega Solar Power Park is also being developed by M/s Saurya Urja Company of Rajasthan Ltd (JVC of Govt. of Rajasthan and IL&FS) for 1000MW capacity and M/s Adani Renewable Energy Park Rajasthan Ltd. (JVC of Govt. of Rajasthan and AREPL) for 500MW capacity as well as by M/s Essel Saurya Company of Rajasthan Ltd (JVC of Govt. of Rajasthan and Essel Infra Projects Ltd) for 750 MW in/near Bhadla, Jodhpur district, Rajasthan. Further, setting up of ultra-mega solar park of 700 MW capacities has been envisaged by M/s Gujarat Power Corporation Limited (GPCL) at Radhanesda district Banaskantha in Gujarat. Ministry of Power (MoP) has assigned POWERGRID to implement transmission system for various solar parks including Banaskantha UMSPP (700 MW) in Gujarat on compressed time schedule basis.

Besides, Rihand-Dadri HVDC system is an important link of Northern Region and is responsible for evacuation of major power out of 3000MW generated at Rihand Generating station. Reliable operation of Rihand-Dadri HVDC is of most importance for smooth operation of Northern Grid as power interruption in the link results in back down of generators in Rihand/Singrauli generating complex and also affects power supply to Delhi/Punjab. Though the system was running satisfactorily till last 3-4 years, problems started arising in different areas of HVDC resulting in outage of HVDC system as well as interruption of power flow. These failures are due to ageing of the equipment as Rihand-Dadri HVDC system has already completed its useful life of 25 years. The project involves refurbishment of Rihand & Dadri HVDC systems which will enhance its life and improve reliability as Rihand-Dadri HVDC system.

The above Inter-State Transmission Scheme (ISTS) for Bhadla, Tumkur (Pavagada) & Banashkantha UMSP were discussed and agreed in the respective Regional Standing committee meetings on Power system Planning held on 20.01.16, 05.03.2016 & 20.01.16 respectively.

To meet the funding requirement for the proposed project, Asian Development Bank (ADB) has accepted POWERGRID's proposal to finance a loan of USD 225 million for implementation of transmission system for three UMSP at Bhadla, Pavagada and Banashkantha and some package of refurbishment of HVDC Rihand-Dadri Project. Moreover, ADB selected the instant project to be implemented and monitored in line with the POWERGRID's Environmental and Social Policy & Procedures and the Action Plan for Safeguards prepared for the use of CSS so as to ensure that ESPP achieve and maintain full equivalence with ADB's SPS, 2009. The funding for the remaining part will be met from POWERGRID's own Internal Resources (IR). The loan no. 3521-IND & 8325-IND were signed on 5 April, 2017 and became effective from 9 May, 2017. The loan closing date is 31 May, 2022.

1.1 OVERALL PROJECT DESCRIPTION

The Solar Transmission Sector Project covered under Loan No. 3521-IND and 8325-IND involves following projects:

- (i) Transmission System associated with Solar Park at Bhadla, Rajasthan
 - Bhadla (POWERGRID) – Bikaner (POWERGRID) 765kV D/c line;
 - Bhadla (POWERGRID)- Bhadla (RVPN) 400kV D/c (Quad) line;
 - Establishment of 765/400/220kV Bhadla (POWERGRID) substation;
 - Extension of 765/400kV Bikaner (POWERGRID) substation;
 - Extension of 400/220kV Bhadla (RVPN) substation.
- (ii) Transmission system for Ultra Mega Solar power park (2000 MW) at Tumkur (Pavagada), Karnataka - Phase-II (Part- A & B)
 - a) Transmission system for Ultra Mega Solar power park (2000 MW) at Tumkur (Pavagada), Karnataka - Phase-II (Part-A)
 - Hiriyur – Mysore 400kV D/C line;
 - Extension of 400/220kV Tumkur (Pavagada) Pooling station;
 - Extension of 400/220kV Mysore (POWERGRID) substation;
 - Extension of 400/220kV Tumkur (Vasantnarsapur) substation;
 - b) Transmission system for Ultra Mega Solar power park (2000 MW) at Tumkur (Pavagada), Karnataka - Phase-II (Part-B);
 - Tumkur Pooling station-Devanahally(KPTCL) 400kV D/c (Quad) Line;
 - Extension of 400/220kV Tumkur (Pavagada) Pooling Station;
 - Extension of 400/220kV Devanahally (KPTCL) substation

- (iii) Transmission system for Ultra Mega Solar Power Park (700 MW) at Banaskantha (Radhanesda), Gujarat
 - Banaskantha (Radhanesda) Pooling Station– Banaskantha 400kV D/c Line;
 - 400kV Bay Extension at 765/400kV Banaskantha (POWERGRID) substation.
- (iv) Refurbishment of HVDC Rihand-Dadri Project
 - Supply & Erection of Bushings for Converter Transformers & Smoothing Reactors at Rihand and Dadri HVDC terminals

1.2 PROJECT OBJECTIVES

The objective is to improve import capability of Northern, Southern & Western regions through transmitting harnessed solar power, which is another sustainable alternative, renewable and non-polluting form of energy and does not emit any Green House Gases (GHGs) or harmful wastes.

1.3 SAFEGUARD CATEGORY

As per ADB’s safeguard classification of projects on the basis of potential impacts, the Solar Transmission Sector Project is categorized as “B” and “C” for Involuntary Resettlement & Indigenous People aspects respectively.

1.4 SOCIAL PERFORMANCE INDICATOR:

The following parameters are considered as key indicators for this project which need to be monitored to evaluate the social performance.

- i) Selection of optimum route/substation site having least social impacts and also avoiding socially sensitive areas like human habitations, places of cultural/historical significance;
- ii) Taking due care of Project Affected Persons (PAPs) including timely payment of compensation and addressing their grievances, if any;
- iii) Compliance to CSS Action Plan for Safeguards & Loan Covenants;
- iv) Compliance to provisions mentioned in Compensation Plan for Temporary Damages (CPTD)/Environment Management Plan (EMP).

1.5 OVERALL PROJECT PROGRESS, AGREED MILESTONES & COMPLETION SCHEDULES

Name of project	Project Details	Progress as on 31 December, 2020	Completion Schedule
Transmission System associated with Solar Park at Bhadla, Rajasthan	Transmission Line: <ul style="list-style-type: none"> • Bhadla (POWERGRID)–Bikaner (POWERGRID) 765kV D/c line • Bhadla (POWERGRID)- Bhadla (RVPN) 400kV D/c (Quad) Substation: <ul style="list-style-type: none"> • Establishment of 765/400/220kV Bhadla (POWERGRID) substation 	Commissioned in September 2019)	Already Commissioned

	<ul style="list-style-type: none"> • Extension of 765/400kV Bikaner (POWERGRID) Substation • Extension of 400/220kV Bhadla (RVPN) Substation 		
Transmission system for Ultra Mega Solar power park (2000 MW) at Tumkur (Pavagada), Karnataka - Phase-II (Part-A & B)	<p>Transmission Line:</p> <ul style="list-style-type: none"> • Hiriyur – Mysore 400kV D/C line; • Tumkur (Pavagada) Pooling station-Devanahally (KPTCL) 400kV D/c (Quad) Line <p>Substation:</p> <ul style="list-style-type: none"> • Extension of 400/220kV Tumkur (Pavagada) Pooling station • Extension of 400/220kV Mysore (POWERGRID) Substation • Extension of 400/220kV Tumkur (Vasantnarsapur) Substation • Extension of 400/220kV Tumkur (Pavagada) Pooling station • Ext. of 400/220kV Devanahally (KPTCL) Substation 	<p>Part-A commissioned in April 2020. Overall- All Tower foundation & erection work completed but stringing - 96 % completed. (Progress during reporting period of July-December 2020 tower foundation-2 %, erection- 11 % & stringing- 14%)</p> <p>All civil work and equipment erection completed.</p>	<p>Part-A commissioned in April 2020. However, due to RoW issues & COVID-19 pandemic commissioning of Part-B is expected by February, 2021.</p>
Transmission system for Ultra Mega Solar Power Park(700 MW) at Banaskantha (Radhanesda), Gujarat	<p>Transmission Line:</p> <ul style="list-style-type: none"> • Banaskantha (Radhanesda) Pooling Station – Banaskantha (PG) 400kV D/c. <p>Substation:</p> <ul style="list-style-type: none"> • 400kV Bay Extension at 765/400kV Banaskantha (PG) Substation 	<p>Commissioned in 30th August, 2020 Progress during reporting period of July-December 2020-Stringing- 5%</p> <p>Commissioned in 30th August, 2020</p> <p>Progress during reporting period of July-December 2020 - Approx. 3% civil work & 5% equipment erection completed.</p>	<p>Already Commissioned</p>

Refurbishment of HVDC Rihand-Dadri Project	<ul style="list-style-type: none"> Supply & Erection of Bushings for Converter Transformers & Smoothing Reactors at Rihand and Dadri HVDC terminal 	Contract awarded in August 2019. Design and engineering work is under progress.	March 2021
--	---	---	------------

SECTION 2: COMPLIANCE STATUS WITH MAJOR LOAN COVENANTS

POWERGRID has complied with various social safeguards as agreed in the loan covenants. The point wise compliance status is presented in the table below;

Project Specific Covenants	Reference	Status of Compliance
<p>The Borrower shall ensure, to ADB's satisfaction, prior to any disbursement of Loan proceeds for the relevant Subproject, the following requirements, as outlined in the PAM: (a) each Subproject meets the Subprojects selection criteria for ADB appraisal; (b) project relevant information of each of the Subprojects is disclosed to affected persons during consultation and prior to ADB appraisal; (c) draft and final EAR, EAMP and SAMP (CPTDT RAP and/or TPDP, as applicable) are submitted to ADB for its review; (d) satisfactory draft, final* and any updated 'EAR, EAMP, and SAMP (CPTD, RAP and/or TPDP, as applicable) are disclosed on the Borrower's website; and (e) submit the same to ADB for disclosure on ADB website.</p>	<p>LA, Sch. 5, para. 10</p>	<p>Complied. IEARs & CPTDs already prepared and disclosed on website after approval of ADB.</p>
<p>The Borrower shall use agency-level CSS to assess, categorize and address any environmental or social impacts under the Project in accordance with the ESPP, the agreed Action Plan for Safeguards, and the provisions set out in paragraphs 12 through 17 of this Schedule.</p>	<p>LA, Sch. 5, para. 11</p>	<p>Complied/Being complied. The detailed compliance status of agreed action plan under CSS is placed as</p>
<p>The Borrower shall adopt and implement the Action Plan for Safeguards in a timely manner so as to ensure that its ESPP achieve and maintain full equivalence with the objectives, policy scope, principles and triggers of SPS throughout Project implementation.</p>		<p>placed as Annexure-1.</p>
<p>The Borrower shall promptly notify ADB of any proposed changes to its ESPP or its safeguards implementation practices pursuant thereto. If, in the reasonable opinion of ADB, the change(s) could have the effect that environmental or social impacts under the Project are no longer assessed, categorized or addressed in a manner consistent with the objectives, policy scope, principles and triggers of SPS, ADB may</p> <p>(i) require such additional changes to the Action Plan for Safeguards or other remedial actions as it considers necessary to maintain such consistency</p> <p>(ii) withdraw its approval for the use of CSS and financing of related Subprojects.</p>	<p>LA, Sch. 5, para. 13</p>	<p>Will be notified in case of any changes in ESPP.</p>
<p>The Borrower shall ensure, or cause to be ensured, that all land and all rights-of-way required for the Project are made available to the works contractor in accordance with the schedule agreed under the related works contract and all land acquisition and resettlement activities are implemented in compliance with (a) all applicable laws and regulations of the Guarantor and the relevant States relating to land acquisition and involuntary resettlement; (b) the ESPP; (c) the Action Plan for Safeguards, and (d) all measures and requirements set forth in the respective SAMP (CPTD, RAP and/or TPDP, as applicable), and any corrective or preventative actions set forth in a Safeguards Monitoring Report.</p>	<p>LA, Sch. 5, para. 15</p>	<p>Complied/Being complied. For details of compliance status refer section -3.</p>

Project Specific Covenants	Reference	Status of Compliance
Without limiting the application of the ESPP, the Action Plan for Safeguards and the relevant SAMP, the Borrower shall ensure that no displacement takes place in connection with the Project until compensation and other entitlements have been provided to affected people. In the case of temporary damages, the Borrower shall apply the provisions of the CPTD. In the case of involuntary land acquisition, the Borrower shall apply the provisions of the RAP.	LA, Sch. 5, para. 16	Complied/Being complied. For details of compliance status refer section -3.
Subject to the provisions of paragraph 11 of this Schedule, in the event of any significant or related impacts on indigenous people, the Borrower shall prepare and implement a TPDP equivalent to an indigenous peoples plan under the SPS in accordance with (a) the applicable laws and regulations of the Guarantor and the relevant States; (b) the ESPP; (c) the Action Plan for Safeguards; and (d) any corrective and preventive actions set forth in a Safeguards Monitoring Report.	LA, Sch. 5, para. 17	No impact on Indigenous people envisaged.
The Borrower shall make available necessary budgetary and human resources to fully implement the ESPP; the Action Plan for Safeguards; and each EAMP and SAMP (CPTD, RAP and/or TPDP, as applicable); and any corrective or preventative actions set forth in a Safeguards Monitoring Report.	LA, Sch. 5, para. 18	Complied/Being complied. All such provisions are integral part of approved IEARs and CPTDs.
<p>The Borrower shall ensure that all bidding documents and contracts for works contain provisions that require contractors to:</p> <ul style="list-style-type: none"> (a) comply with the measures relevant to the contractor set forth in the relevant IEAR, EAMP, and SAMP (CPTD, RAP and/or TPDP as applicable), (to the extent they concern impacts on affected people during construction), and any corrective or preventative actions set forth in the Action Plan for Safeguards and Safeguards Monitoring Report; (b) make available a budget for all such environmental and social measures and monitoring activities (c) provide the Borrower with a written notice of (i) any unanticipated environmental, resettlement or indigenous peoples risks or impacts that arise during construction, implementation or operation of the Project that were not considered in the relevant IEAR, EAMP, and SAMP (CPTD, RAP and/or TPDP, as applicable), and (ii) any corrective or preventative actions set forth in the Action Plan for Safeguards and Safeguards Monitoring Report (d) adequately record the condition of roads, agricultural land and other infrastructure prior to starting to transport materials and construction; and (e) reinstate pathways, other local infrastructure, and agricultural land to at least their pre-project condition upon the completion of construction. 	LA, Sch. 5, para. 19	Point (a) to (d) complied and point (e) is being complied as it is completed with project implementation at site.

<p>The Borrower shall do the following, consistent with Action Plan for Safeguards:</p>	<p>LA, Sch. 5, para. 20</p>	<p>Complied/ Being complied</p>
<p>(a) disclose Safeguards Monitoring Reports on the Borrowers website, and submit the same for disclosure on ADB website, on a semiannual basis;</p>		<p>Such reports are being submitted in due time and disclosed on website after ADB clearance.</p>
<p>(b) disclose satisfactory revisions and updates of IEAR, EAMP, and SAMP (CPTD, RAP and/or TPDP, as applicable), prepared during Subproject implementation, if any, on the Borrower's website, and submit these to ADB for disclosure on ADB website, and provide relevant information to affected people and other stakeholders in a timely manner and in a form and language understandable to them;</p>		<p>Updated CPTD for Bhadla submitted on 1st February, 2020 for approval. Remaining CPTDs shall be submitted based on observations/ approval from ADB on Bhadla CPTD</p>
<p>(c) if any unanticipated environmental and/or social risks and impacts arise during construction, implementation or operation of the Project that were not considered in the relevant IEAR, EAMP, and SAMP (CPTD, RAP and/or TPDP as applicable), promptly inform ADB of the occurrence of such risks or impacts, with detailed description of the event and proposed corrective action plan;</p>		<p>Measures in response to unanticipated impacts due COVID-19 outbreak have already been shared with ADB in May, 2020 (Appendix-1).</p>
<p>(d) report any actual or potential breach of compliance with the measures and requirements set forth in the relevant EAMP, and SAMP (CPTD, RAP and/or TPDP, as applicable) promptly after becoming aware of the breach; and</p>		<p>Will be complied in case of any breach. But till date no such breach reported.</p>
<p>(e) in the event unexpected significant safeguard impacts are identified, promptly engage qualified and experienced external expert or agency under terms of reference intimated to ADB, to verify information produced through the Project monitoring process, and facilitate the carrying out of any verification activities by such external experts.</p>		<p>Will be complied if situation warrants</p>

SECTION: 3 STATUS OF LAND & SOCIAL COMPLIANCES

Details of land required for proposed substations, land status and social compliance is given below in **Table 1**.

Table 1: Details of Substation Land

S. N	Name of Substation	Land Area (acre)/ Type	Land Status	Land Cost	Social Compliance
1	Bhadla substation	130.91/ Govt	State Govt. transferred land to POWERGRID on 14.07.2016	Rs. 26.00 million	No R&R issues involved hence, there is no need of Rehabilitation Action Plan (RAP).
2	Extension of Bikaner, Tumkur (Pavagada), Tumkur (Vasantnarsapur) & Mysore substation	The required lands for said extensions are already available in respective existing substations of POWERGRID. Since , no fresh land is secured, there is no need of Rehabilitation Action Plan (RAP)			

A summary of the environmental & social mitigation measures, their monitoring vis-à-vis compliance by POWRGRID is given in **Table- E1**.

a. Compensation for Tree/crop damages:

POWERGRID follows the principles of Avoidance, Minimization and Mitigation in the construction of lines in agricultural field due to inherent flexibility in phasing the construction activity and tries to defer construction in cropped area to facilitate crop harvesting. However, if it is unavoidable and is likely to affect project schedule, compensation is given at market rate (rate fixed by State Govt.) for standing crops. The process of tree/crop compensation is depicted in **Figure 1**. All efforts are also taken to minimize the crop damage to the extent possible in such cases. In the instant project also POWERGRID is taking all possible measures to avoid damages to crop/trees by taking up the construction activities during lean period or post-harvest season. As per the prevailing norms farming activity is allowed after the construction work is completed. However, compensation for the loss of crops/trees/any structure are paid to Affected Persons (APs) for the area of damage to mitigate the impacts separately 3 times, wherever applicable i.e. during foundation work, tower erection & stringing. Details of line wise compensation paid for Tree & Crop damages for the reporting period (July-December, 2020) and up to December, 2020 are given below in **Table- 2 & Table-3** respectively.

Table 2: Details of Crop & Tree Compensation during Reporting Period July-December, 2020

S. No.	Name of the Line	Nos. of Person issued notice	Affected Land Area (Ha.)	Nos. of Tree	Compensation Paid for crop damages (Rs million)			Compensation Paid for Tree damages (Rs million)		
					Fdn.	Erectn.	Stringing	Fdn.	Erectn.	Strg.
A	Transmission System Associated with Solar Park at Bhadla, Rajasthan									
1	765 kV D/C Bhadla- Bikaner	Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil
2	400 kV D/C Bhadla-Bhadla	Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil

Sub-total (A)		Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil	Nil
B	Transmission System for UMSPP at Tumkur (Pavagada), Karnataka-Phase-II (Part-A & B)									
1	400 kV D/C Hiriyur-Mysore	426	6.83	2995	0.65	0.11	0.85	0	0	7.37
2	400 kV D/C Tumkur-De.hally	138	1.53	87	0.35	0.72	0.35	Nil	Nil	Nil
Sub-total (B)		564	8.36	3082	1.00	0.83	1.20	0.00	0.00	7.37
C	Transmission System for Ultra Mega Solar Power Park at Banaskantha, Gujarat									
1	400 kV D/C B.kantha-B.kantha	414	22.114	5181	Nil	Nil	7.25	Nil	Nil	7.62
Sub-total(C)		414	22.114	5181	0	0	7.25	0	0	7.62
Grand Total		978	30.474	8263	1.00	0.83	8.45	0.00	0.00	14.99

As it can be evident from the table above, most of the activities in this reporting period has been undertaken in subproject associated with UMSPP at Tumkur (Pavagada), Karnataka- Phase-II (Part-A & B) & Ultra Mega Solar Power Park at Banaskantha, Gujarat as project activities associated with Solar Park at Bhadla, Rajasthan has already been completed. A total of 978 notices to APs for a land area of 30.474 ha has been issued. A total of **Rs.10.28 million** has been disbursed towards crop compensation during foundation, erection and stringing combined. Similarly, a total of **Rs. 14.99 million** has been disbursed as compensation for loss of 8263 trees during reporting period.

Table 3: Details of Crop & Tree Compensation till December, 2020

S. No.	Name of the Line	Nos. of Person issued notice	Affected Land Area (Ha.)	Nos. of Tree	Compensation Paid for crop damages(Rs million)			Compensation Paid for Tree damages(Rs million)		
					Fdn.	Erectn.	Stringing	Fdn.	Erectn.	Strg.
A	Transmission System Associated with Solar Park at Bhadla, Rajasthan									
1	765 kV D/C Bhadla- Bikaner	987	568.53	Nil	14.454	15.04	10.58	Nil	Nil	Nil
2	400 kV D/C Bhadla-Bhadla	96	41.35	Nil	1.08	1.4	1.58	Nil	Nil	Nil
Sub-total (A)		1083	609.88	Nil	15.534	16.44	12.16	Nil	Nil	Nil
B	Transmission System for UMSPP at Tumkur (Pavagada), Karnataka- Phase-II (Part-A & B)									
1	400 kV D/C Hiriyur-Mysore	6065	260.83	37796	11.87	12.18	25.94	0.15	0.70	231.54
2	400 kV D/C Tumkur-De.hally	2399	266.97	201	8.47	3.42	6.88	1.25	Nil	7.38
Sub-total (B)		8464	527.8	37997	20.34	15.60	32.82	1.4	0.70	238.92
C	Transmission System for Ultra Mega Solar Power Park at Banaskantha, Gujarat									
1	400 kV D/C Bkantha-B.kantha	1668	173.834	5602	11.75	12.036	35.67	Nil	Nil	8.17
Sub-total(C)		1668	173.834	5602	11.75	12.036	35.67	Nil	Nil	8.17
Grand Total		11215	1311.514	43599	47.624	44.076	80.65	1.4	0.7	247.09

During reporting period of July-December 2020, compensation to the tune of **Rs 25.27 million** has been paid towards crop & tree damages for notices issued to 978 people for 30.474 ha. of land. As of December, 2020, a total of **Rs 421.54 million** has been paid towards tree/crop compensation against the provision of Rs. 318.90 million as per DPR.

Similarly, as of December 2020, a total of 11,215 affected persons with notice have received compensation, and the compensation progress is around 132.19 % based on DPR due to escalation in cost and expected to be completed soon with the project implementation. No structure has been identified yet. A sample copy of tree/crop compensation notice along with assessment sheet is enclosed as **Annexure-2**.

b. Land Compensation as per MoP Guidelines

Ministry of Power (MoP), Govt of India vide their guidelines dated 15 October, 2015 mandated payment of 85% land cost for the land coming under tower base and payment of maximum 15% of land cost for the land coming under the line corridor. However, these guidelines are subject to adoption by state governments for implementation in respective states. Till date, Govt. of Gujarat & Karnataka have adopted these guidelines among the states, where the project is being executed, while State of Rajasthan is yet to adopt these guidelines. The details of land compensation paid during reporting period (July-December, 2020) and up to December, 2020 as per the provisions of the said guidelines are given in **Table- 4 & Table- 5** respectively:

Table -4: Details of Land Compensation paid during reporting period (July-December, 2020) as per MoP Guidelines

S. No.	Name of the Line	Total Compensation paid for area under Tower Base (Rs million)	Total Compensation paid for area under RoW Corridor (Rs million)	Rate of Land Compensation (Rs million)	Remark, if any
A. Transmission System Associated with Solar Park at Bhadla, Rajasthan					
1	765 kV D/C Bhadla- Bikaner	Not Applicable	Not Applicable	Not Applicable	Rajasthan State has yet to adopt MoP Guidelines
2	400 kV D/C Bhadla-Bhadla				
B. Transmission System for UMSP at Tumkur, Karnataka- Phase-II (Part-A & B)					
1	400 kV D/C Hiriyur-Mysore	5.79	119.1	DA-0.225, DB-0.25-0.56, DC-0.30-0.55 DD-0.40-0.52	
2	400 kV D/C Tumkur-Devanahally	149.6	596.66	DA-0.225, DB-0.25, DC-0.30, DD-0.40 Corridor- 0.20/ acre	
C Transmission System for UMSP at Banaskantha, Gujarat					
1	400 kV D/C Banaskantha-Banaskantha	1.93	16.65	700-1367	
Total		157.32	732.41		

Table -5 : Details of Land Compensation up to December, 2020 as per MoP Guidelines

S. No.	Name of the Line	Total Compensation paid for area under Tower Base (Rs million)	Total Compensation paid for area under RoW Corridor (Rs million)	Rate of Land Compensation (Rs million)	Remark, if any
A. Transmission System Associated with Solar Park at Bhadla, Rajasthan					
1	765 kV D/C Bhadla- Bikaner	Not Applicable	Not Applicable	Not Applicable	Rajasthan State has yet to adopt MoP Guidelines
2	400 kV D/C Bhadla-Bhadla				
B. Transmission System for UMSP at Tumkur, Karnataka- Phase-II (Part-A & B)					
1	400 kV D/C Hiriyur-Mysore	137.807	584.83	DA-0.225, DB-0.25-0.56, DC-0.30-0.55 DD-0.40-0.52	
2	400 kV D/C Tumkur-Devanahally	506.77	891.89	DA-0.225, DB-0.25, DC-0.30, DD-0.40 Corridor- 0.20/ acre	
C. Transmission System for UMSP at Banaskantha, Gujarat					
1	400 kV D/C Banaskantha-Banaskantha	27.87	194.46	700-1003	
Total		672.447	926.87		

Figure 1 : TREE / CROP COMPENSATION PROCESS

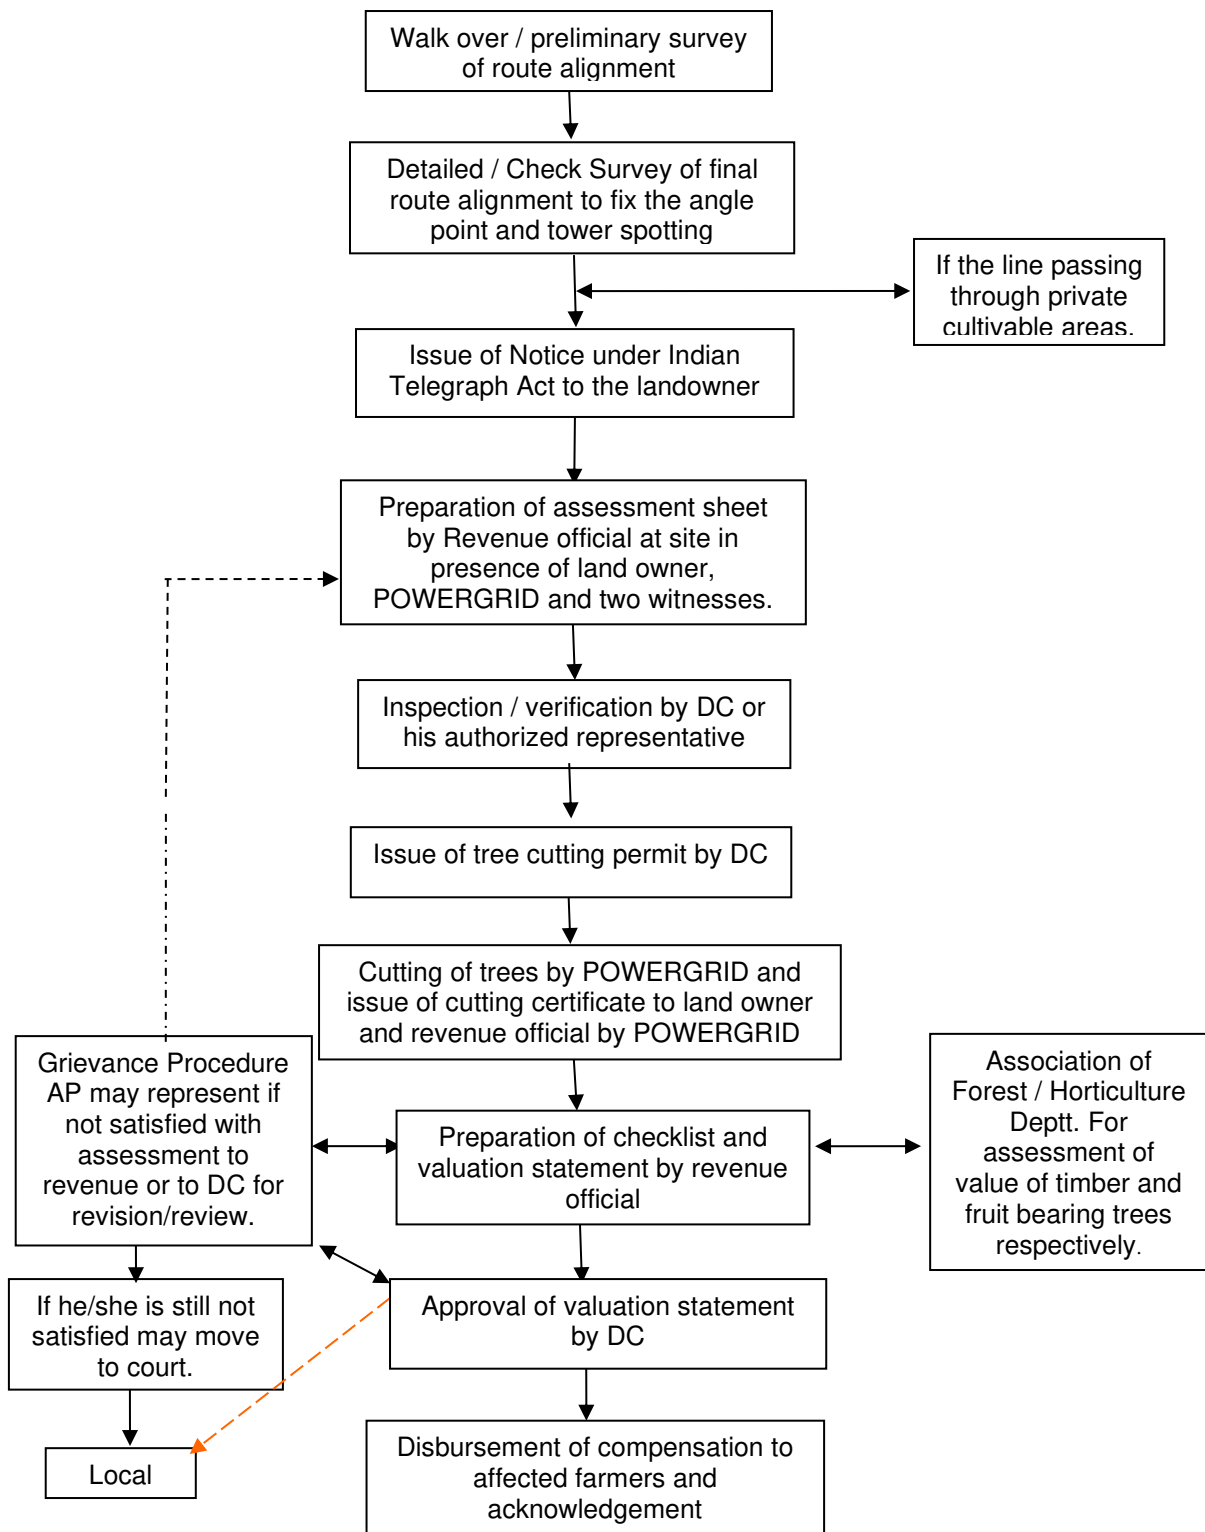


TABLE – E1 : ENVIRONMENT MANAGEMENT PLAN

Cl. No/ stage	Project activity	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
Pre-construction								
1	Location of line towers and line alignment and design	Exposure to safety related risks	Setback of dwellings to line route designed in accordance with permitted level of power frequency and the regulation of supervision at sites	Tower location and alignment selection with respect to nearest dwellings	Setback distances to nearest houses – once	POWERGRID	Part of tower sitting survey and detailed alignment survey & design	Complied. Details of compliance provided in environment monitoring report separately.
2	Equipment specifications and design parameters	Release of chemicals and gases in receptors (air, water, land)	PCBs not used in substation transformers or other project facilities or equipment.	Transformer design	Exclusion of PCBs in transformers stated in tender specification – once	POWERGRID	Part of tender specifications for the equipment	
			Processes, equipment and systems not to use chloro-fluorocarbons (CFCs), including halon, and their use, if any, in existing processes and systems should be phased out and to be disposed of in a manner consistent with the requirements of the Govt.	Process, equipment and system design	Exclusion of CFCs stated in tender specification – once	POWERGRID	Part of tender specifications for the equipment	
Phase out schedule to be prepared in case still in use – once	Part of equipment and process design							
3	Transmission line design	Exposure to electromagnetic interference	Line design to comply with the limits of electromagnetic interference from power lines including those of ICNIRP	Electromagnetic field strength for proposed line design	Line design compliance with relevant standards – once	POWERGRID	Part of design parameters	
4	Substation location and design	Exposure to noise	Design of plant enclosures to comply with National ambient noise standards which are also compatible with the EHS guidelines of the World Bank.	Expected noise emissions based on substation design	Compliance with regulations - once	POWERGRID	Part of detailed sitting survey and design	Complied/ being complied. Details of compliance provided in environment monitoring report separately.

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
		Social inequities	Careful selection of site to avoid encroachment of socially, culturally and archaeological sensitive areas (i.e. sacred groves, graveyard, religious worship place, monuments etc.)	Selection of substation location (distance to sensitive area).	Consultation with local authorities - once	POWERGRID	Part of detailed siting survey and design	Complied during survey. Route alignment criterion is part of survey contract.
5	Location of line towers & line alignment and design	Impact on water bodies	Avoidance of such water bodies to the extent possible. Avoidance of placement of tower inside water bodies to the extent of possible	Tower location and line alignment selection (distance to water bodies)	Consultation with local authorities – once	POWERGRID	Part of tower siting survey and detailed alignment survey and design	Complied Route alignment criterion is part of survey contract.
Social inequities		Careful route selection to avoid existing settlements and sensitive locations	Tower location & line alignment selection (distance to nearest dwellings or social institutions)	Consultation with local authorities and land owners – once				
		Minimise impact on agricultural land	Tower location & line alignment selection (distance to agricultural land)	Consultation with local authorities and land owners – once				
		Careful selection of site and route alignment to avoid encroachment of socially, culturally & archaeological sensitive areas (i. g. sacred groves, graveyard, religious worship place, monuments etc.)	Tower location and line alignment selection (distance to sensitive area)	Consultation with local authorities - once				

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
6	Securing lands for substations.	Loss of land/ income change in social status etc.	In the case of Involuntary Acquisitions, Compensation and R&R measures are extended as per provision of RFCTLARRA, 2013 ¹	Compensation and monetary R&R amounts/ facilities extended before possession of land.	As per provisions laid out in the act	POWERGRID	Prior to award/start of substation construction.	Fresh land required only for Bhadla substation which was secured from State Govt through transfer. For details refer Table- 1.
7	Line through protected area/ precious ecological area	Loss of precious ecological values/ damage to precious species	Avoid siting of lines through such areas by careful site and alignment selection (National Parks, Wildlife Sanctuary, Biosphere Reserves/ Biodiversity Hotspots)	Tower location & line alignment selection (distance to nearest designated ecological protected/ sensitive areas)	Consultation with local forest authorities - once	POWERGRID	Part of tower siting survey and detailed alignment survey and design	Complied/ being complied. Details of compliance provided in environment monitoring report separately.
			Minimize the need by using RoW wherever possible	Tower location and line alignment selection	Consultation with local authorities & design engineers- once			
8	Line through identified Elephant corridor / Migratory bird	Damage to the Wildlife/ Birds and also to line	Study of earmarked elephant corridors to avoid such corridors, Adequate ground clearance, Fault clearing by Circuit Breaker, Barbed wire wrapping on towers, reduced spans etc., if applicable	Tower location and line alignment selection. Minimum /maximum ground clearance	Consultation with local forest authorities – once. Monitoring – quarterly basis	POWERGRID	Part of tower siting and detailed alignment survey & design and Operation	

¹ No Involuntary acquisition of land (permanent) involved, hence this clause is not applicable.

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
			Avoidance of established/ identified migration path (Birds & Bats). Provision of flight diverter/ reflectors, bird guard, elevated perches, insulating jumper loops, obstructive perch deterrents, raptor hoods etc2., if applicable	Tower location and line alignment selection	Consultation with local forest authorities - once	POWERGRID	Part of tower siting survey and detailed alignment survey and design	
9	Line through forestland	Deforestation and loss of biodiversity edge effect	Avoid locating lines in forest land by careful site and alignment selection	Tower location and line alignment selection (distance to nearest protected or reserved forest)	Consultation with local authorities-once	POWERGRID	Part of tower siting survey and detailed alignment survey and design	
	Minimise the need by using existing towers, tall towers and RoW, wherever possible		Consultation with local authorities & design engineers- once					
	Measures to avoid invasion of alien species		Intrusion of invasive species	Consultation with local forest authorities-once				
	Obtain statutory clearances from the Government		Statutory approvals from Government	Compliance with regulations – once for each subproject				
10	Lines through farmland	Loss of agricultural production/ change in cropping pattern	Use existing tower or footings wherever possible.	Tower location and line alignment selection.	Consultation with local authorities and design engineers – once	POWERGRID	Part of detailed alignment survey and design	Complied during survey which is a part of survey contract. However, as per law of land, no land is acquired for trans. line tower but all damages are compensated as per provisions of Electricity Act, 2003 and Indian Telegraph Act, 1885.

² As per International/National best practices and in consultation with concerned forest/wildlife Authority.

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
			Avoid sitting new towers on farmland wherever feasible	Tower location and line alignment selection	Consultation with local authorities & design engineers- once		Part of detailed sitting & alignment survey /design	
11	Noise related	Nuisance to neighbouring properties	Substations sited and designed to ensure noise will not be a nuisance and shall comply with National Ambient Noise Standards, which are also compatible with the EHS guidelines of the World Bank.	Noise levels	Noise levels to be specified in tender documents- once	POWERGRID	Part of detailed equipment design	Complied/ being complied. Details of compliance provided in environment monitoring report separately.
12	Interference with drainage patterns/ irrigation channels	Flooding hazards/ loss of agricultural production	Appropriate sitting of towers to avoid channel interference	Tower location and line alignment selection (distance to nearest flood zone)	Consultation with local authorities and design engineers- once	POWERGRID	Part of detailed alignment survey and design	Complied/Being complied. Appropriate siting of towers ensured during alignment survey and Tower spotting to avoid channel interference.
13	Escape of polluting materials	Environmental pollution	Transformers designed with oil spill containment systems, and purpose-built oil, lubricant and fuel storage system, complete with spill cleanup equipment.	Equipment specifications with respect to potential pollutants	Tender document to mention specifications – once	POWERGRID	Part of detailed equipment design /drawings	Complied/ being complied. Details of compliance provided in environment monitoring report separately.
			Substations to include drainage and sewage disposal systems to avoid offsite land and water pollution.	Substation sewage design	Tender document to mention detailed specifications – once	POWERGRID	Part of detailed substation layout and design /drawings	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
14	Equipments submerged under flood	Contamination of receptors	Substations constructed above the high flood level(HFL) by raising the foundation pad	Substation design to account for HFL (elevation with respect to HFL elevation)	Base height as per flood design- once	POWERGRID	Part of detailed substation layout and design/ drawings	
15	Explosions /Fire	Hazards to life	Design of substations to include modern firefighting equipment Provision of fire fighting equipment to be located close to transformers	Substation design compliance with fire prevention and control codes	Tender document to mention detailed specifications – once	POWERGRID	Part of detailed substation layout and design /drawings	
Construction								
16	Equipment layout and installation	Noise and vibrations	Construction techniques and machinery selection seeking to minimize ground disturbance.	Construction techniques and machinery	Construction techniques and machinery creating minimal ground disturbance- once at the start of each construction phase	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ being complied. Details of compliance provided in environment monitoring report separately
17	Physical construction	Disturbed farming activity	Construction activities on cropping land timed to avoid disturbance of field crops (within one month of harvest wherever possible).	Timing of start of construction	Crop disturbance – Post harvest as soon as possible but before next crop – once per site	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ Being complied. Construction on farm land undertaken mostly during post-harvest period. Wherever, crop loss occurs, compensation is paid to farm owners. An amount of Rs 172.35 million has been paid till December'20 (for details refer Table -3).

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
18	Mechanized construction	Noise, vibration and operator safety, efficient operation	Construction equipment to be well maintained.	Construction equipment – estimated noise emissions	Complaints received by local authorities – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ being complied. Details of compliance provided in environment monitoring report separately.
		Noise, vibration, equipment wear and tear	Turning off plant not in use.	Construction equipment – estimated noise emissions and operating schedules	Complaints received by local authorities – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
19	Construction of roads for accessibility	Increase in airborne dust particles	Existing roads and tracks used for construction and maintenance access to the line wherever possible.	Access roads, routes (length and width of new access roads to be constructed)	Use of established roads wherever possible – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ being complied. Details of compliance provided in environment monitoring report separately.
		Increased land requirement for temporary accessibility	New access ways restricted to a single carriageway width within the RoW.	Access width (meters)	Access restricted to single carriage – way width within RoW – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
20	Construction activities	Safety of local villagers	Coordination with local communities for construction schedules, Barricading the construction area and spreading awareness among locals	Periodic and regular reporting /supervision of safety arrangement	No. of incidents- once every week	POWERGRID (Contractor through contract provisions)	Construction period	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
		Local traffic obstruction	Coordination with local authority, requisite permission for smooth flow of traffic. Imposing speed limits on Project vehicles in project/habitation areas.	Traffic flow (Interruption of traffic)	Frequency (time span)- on daily basis	POWERGRID (Contractor through contract provisions)	Construction period	
21	Temporary blockage of utilities	Overflows, reduced discharge	Measure in place to avoid dumping of fill materials in sensitive drainage area	Temporary fill placement (m3)	Absence of fill in sensitive drainage areas – every 4 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
22	Site clearance	Vegetation	Marking of vegetation to be removed prior to clearance, and strict control on clearing activities to ensure minimal clearance. No use of herbicides and pesticides	Vegetation marking and clearance control (area in m2)	Clearance strictly limited to target vegetation – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
23	Trimming /cutting of trees within RoW	Fire hazards	Trees allowed growing up to a height within the RoW by maintaining adequate clearance between the top of tree and the conductor as per the regulations.	Species-specific tree retention as approved by statutory authorities (average and max. tree height at maturity, in meters)	Presence of target species in RoW following vegetation clearance – once per site	POWERGRID (Contractor through contract provisions)	Construction period	
		Loss of vegetation and deforestation	Trees that can survive pruning to comply should be pruned instead of cleared.	Species-specific tree retention as approved by statutory authorities	Presence of target species in RoW following vegetation clearance-once per site	POWERGRID (Contractor through contract provisions)	Construction period	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
			Felled trees and other cleared or pruned vegetation to be disposed of as authorized by the statutory bodies.	Disposal of cleared vegetation as approved by the statutory authorities (area cleared in m ²)	Use or intended use of vegetation as approved by the statutory authorities – once per site	POWERGRID (Contractor through contract provisions)	Construction period	
24	Wood/vegetation harvesting	Loss of vegetation and deforestation	Construction workers prohibited from harvesting wood in the project area during their employment, (apart from locally employed staff continuing current legal activities).	Illegal wood /vegetation harvesting (area in m ² , number of incidents reported)	Complaints by local people or other evidence of illegal harvesting – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
25	Surplus earthwork/soil	Runoff to cause water pollution, solid waste disposal	Soil excavated from tower footings/ substation foundation disposed of by placement along roadsides, or at nearby house blocks if requested by landowners.	Soil disposal locations and volume (m ³)	Acceptable soil disposal sites – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
26	Substation construction	Loss of soil	Loss of soil is not a major issue as excavated soil will be mostly reused for leveling and re-filling. However, in case of requirement of excess soil the same will be met from existing quarry or through deep excavation of existing pond or other nearby barren land with agreement of local communities.	Borrow area sitting (area of site in m ² and estimated volume in m ³)	Acceptable soil borrow areas that provide a benefit - every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
		Water pollution	Construction activities involving significant ground disturbance (i.e. substation land forming) not undertaken during the monsoon season	Seasonal start and finish of major earthworks (PH, BOD /COD, Suspended solids, others)	Timing of major disturbance activities –prior to start of construction activities	POWERGRID (Contractor through contract provisions)	Construction period	
27	Site clearance	Vegetation	Tree clearances for easement establishment to only involve cutting trees off at ground level or pruning as appropriate, with tree stumps and roots left in place and ground cover left undisturbed	Ground disturbance during vegetation clearance (area, m2) Statutory approvals	Amount of ground disturbance – every 2 weeks Statutory approvals for tree clearances- once for each site	POWERGRID (Contractor through contract provisions)	Construction period	
28	Tower erection Substation foundation- disposal of surplus earthwork/fill	Waste disposal	Excess fill from substation /tower foundation excavation disposed of next to roads or around houses, in agreement with the local community or landowner.	Location and amount (m3)of fill disposal	Appropriate fill disposal locations – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
29	Storage of chemicals and materials	Contamination of receptors (land, water, air)	Fuel and other hazardous materials securely stored above high flood level.	Location of hazardous material storage; spill reports (type of material spilled, amount (kg or m3) and action taken to control and clean up spill)	Fuel storage in appropriate locations and receptacles – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
30	Construction schedules	Noise nuisance to neighbouring properties	Construction activities only undertaken during the day and local communities informed of the construction schedule.	Timing of construction (noise emissions, [dB(A)])	Daytime construction only – every 2 weeks	POWERGRID (Contractor through contract provisions)	Construction period	
31	Provision of facilities for construction workers	Contamination of receptors (land, water, air)	Construction workforce facilities to include proper sanitation, water supply and waste disposal facilities.	Amenities for Workforce facilities	Presence of proper sanitation, water supply & waste disposal facilities – once each new facility	POWERGRID (Contractor through contract provisions)	Construction period	
32	Influx of migratory workers	Conflict with local population to share local resources	Using local workers for appropriate asks	Avoidance/reduction of conflict through enhancement/augmentation of resource requirements	Observation & supervision—on weekly basis	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ Being Complied. Local workforce being used based on skill and no incidents of conflict have been reported till date.
33	Lines through farmland	Loss of agricultural productivity	Use existing access roads wherever possible	Usage of existing utilities	Complaints received by local people /authorities - every 4 weeks	POWERGRID (Contractor through contract provisions)	Construction period	Being complied. No complaints received from local peoples/authorities
			Ensure existing irrigation facilities are maintained in working condition	Status of existing facilities				
			Protect /preserve topsoil and reinstate after construction completed	Status of facilities (earthwork in m ³)				
			Repair /reinststate damaged bunds etc after construction completed	Status of facilities (earthwork in m ³)				

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
		Loss of income.	Land owners/ farmers compensated for any temporary loss of productive land as per existing regulation.	Process of Crop/tree compensation in consultation with forest dept.(for timber yielding tree) and Horticulture deptt. (for fruit bearing tree)	Consultation with affected land owner prior to implementation and during execution.	POWERGRID	During construction	Tried to minimise the loss. However, if any damage occurs to tree/crop same is compensated. Till December'20 Rs 421.54 million and Rs 1599.317 million have been paid towards crops / tree compensation and land diminution value to affected farmer/land owners respectively (refer Table -3 & 5).
34	Uncontrolled erosion/silt runoff	Soil loss, downstream siltation	<p>Need for access tracks minimised, use of existing roads.</p> <p>Limit site clearing to work areas</p> <p>Regeneration of vegetation to stabilise works areas on completion (where applicable)</p> <p>Avoidance of excavation in wet season</p> <p>Water courses protected from siltation through use of bunds and sediment ponds</p>	Design basis and construction procedures (suspended solids in receiving waters; area re-vegetated in m ² ; amount of bunds constructed [length in meter, area in m ² , or volume in m ³])	Incorporating good design and construction management practices – once for each site	POWERGRID (Contractor through contract provisions)	Construction period	Details of compliance provided separately in environment monitoring report

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
35	Nuisance to nearby properties	Losses to neighbouring land uses/values	Contract clauses specifying careful construction practices.	Contract clauses	Incorporating good construction management practices – once for each site	POWERGRID (Contractor through contract provisions)	Construction period	Complied/ Being Complied. No complaints received so far.
			As much as possible existing access ways will be used	Design basis and layout	Incorporating good design engineering practices– once for each site			
			Productive land will be reinstated following completion of construction	Reinstatement of land status (area affected, m ²)	Consultation with affected parties – twice – immediately after completion of construction and after the first harvest			
		Social inequities	Compensation will be paid for loss of production, if any.	Implementation of Tree/Crop compensation (amount paid)	Consultation with affected parties – once in a quarter	POWERGRID	Prior to construction	Compensation provided as per POWERGRID's procedure for tree/crop compensation. Till December'20, an amount of Rs 421.54 million already paid towards crops & tree compensation (for details refer Table -3).

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
36	Flooding hazards due to construction impediments of natural drainage	Flooding & loss of soils, contamination of receptors (land, water)	Avoid natural drainage pattern/ facilities being disturbed/blocked/ diverted by on-going construction activities	Contract clauses (e.g. suspended solids and BOD/COD in receiving water)	Incorporating good construction management practices-once for each site	POWERGRID (Contractor through contract provisions)	Construction period	Details of compliance provided which part of environment monitoring report
37	Equipment submerged under flood	Contamination of receptors (land, water)	Equipment stored at secure place above the high flood level(HFL)	Store room level to be above HFL (elevation difference in meters)	Store room level as per flood design-once	POWERGRID	Construction period	
38	Inadequate siting of borrow areas (quarry areas)	Loss of land values	Existing borrow sites will be used to source aggregates, therefore, no need to develop new sources of aggregates	Contract clauses	Incorporating good construction management practices – once for each site	POWERGRID (Contractor through contract provisions))	Construction period	
39	Health and safety	Injury and sickness of workers and members of the public	Safety equipment's (PPEs) for construction workers	Contract clauses (18.1.3, 18.3.1.1, 18.3.1.4 etc) (requirements of worker camp, number of incidents and total lost-work days caused by injuries and sickness)	Contract clauses compliance – once every quarter	POWERGRID (Contractor through contract provisions)	Construction period	
			Contract provisions specifying minimum requirements for construction workers camps					
			Contractor to prepare and implement a health and safety plan.					
		Contractor to arrange for health and safety training sessions						
40	Inadequate construction stage monitoring	Likely to maximise damages	Training of environmental monitoring personnel	Training schedules	No. of programs attended by each person – once a year	POWERGRID	Routinely throughout construction period	Provides proper training and have very good environment monitoring process. Provides

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
			Implementation of effective environmental monitoring and reporting system using checklist of all contractual environmental requirements	Respective contract checklists and remedial actions taken thereof.	Submission of duly completed checklists of all contracts for each site – once			proper training and have very good env. monitoring process. Training program are regularly conducted. During reporting period such training programs were conducted online on 6 & 7 August, and 16 October, 2020. Training modules are placed as Annexure-3 .
			Appropriate contact clauses to ensure satisfactory implementation of contractual environmental mitigation measures.	Compliance report related to environmental aspects for the contract	Submission of duly completed compliance report for each contract – once			
Operation and Maintenance								
41	Location of line towers and line alignment & design	Exposure to safety related risks	Setback of dwellings to overhead line route designed in accordance with permitted level of power frequency and the regulation of supervision at sites.	Compliance with setback distances (“as-built” diagrams)	Setback distances to nearest houses – once in quarter	POWERGRID	During operation	Complied. Details of compliance provided which part of environment monitoring report
42	Line through identified bird flyways, migratory path	Injury/ mortality to birds, bats etc. due to collision and electrocution	Avoidance of established/ identified migration path (Birds & Bats). Provision of flight diverter/reflectors, elevated perches, insulating jumper loops, obstructive perch deterrents, raptor hoods etc., if applicable	Regular monitoring for any incident of injury/mortality	No. of incidents- once every month	POWERGRID	Part of detailed siting and alignment survey /design and operation	
43	Equipment submerged under flood	Contamination of receptors (land, water)	Equipment installed above the high flood level (HFL) by raising the foundation pad.	Substation design to account for HFL (“as-built” diagrams)	Base height as per flood design – once	POWERGRID	During operation	

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
44	Oil spillage	Contamination of land/nearby water bodies	Each transformer has a secure and impervious underlying pit with a storage capacity of at least 20% of the total oil volume of the transformer and the individual pits are connected to a main collection sump of capacity of 220% of largest transformer oil volume, which acts as a Secondary Containment, in case of a leakage. (refer para 8.6 of TS)	Substation bunding (Oil sump) ("as-built" diagrams)	Bunding (Oil sump) capacity and permeability - once	POWERGRID	During operation	Complied/ being complied. Details of compliance provided in environment monitoring report
45	SF ₆ management	Emission of most potent GHG causing climate change	Reduction of SF6 emission through awareness, replacement of old seals, proper handling & storage by controlled inventory and use, enhance recovery and applying new technologies to reduce leakage	Leakage and gas density/level	Continuous monitoring	POWERGRID	During Operation	
46	Inadequate provision of staff/workers health and safety during operations	Injury and sickness of staff /workers	Careful design using appropriate technologies to minimise hazards	Usage of appropriate technologies (lost work days due to illness and injuries)	Preparedness level for using these technologies in crisis – once each year	POWERGRID	Design and operation	Complied/ being complied. All safety related precautions/ systems/ plans are in place. Proper safety training for workers are
			Safety awareness raising for staff.		Number of programs and			

Cl. No/	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
			Preparation of fire emergency action plan and training given to staff on implementing emergency action plan	Training/awareness programs and mock drills	per cent of staff /workers covered – once each year			conducted on regular interval including mock drills on fire and other occupational hazards.
			Provide adequate sanitation and water supply facilities	Provision of facilities	Complaints received from staff /workers every 2 weeks			
47	Electric Shock Hazards	Injury/ mortality to staff and public	Careful design using appropriate technologies to minimise hazards	Usage of appropriate technologies (no. of injury incidents, lost work days)	Preparedness level for using these technology in crisis- once a month	POWERGRID	Design and Operation	Complied/ being complied. Details of compliance provided which part of environment monitoring report
			Security fences around substations	Maintenance of fences	Report on maintenance – every 2 weeks			
			Barriers to prevent climbing on/ dismantling of towers	Maintenance of barriers				
			Appropriate warning signs on facilities	Maintenance of warning signs				
			Electricity safety awareness raising in project areas	Training/awareness programs and mock drills for all concerned parties	Number of programs and per cent of total persons covered –once each year			
48	Operations and maintenance staff skills less than acceptable	Unnecessary environmental losses of various types	Adequate training in O&M to all relevant staff of substations & line maintenance crews.	Training/awareness programs and mock drills for all relevant staff	Number of programs and per cent of staff covered – once each year	POWERGRID	Operation	
			Preparation and training in the use of O&M manuals and standard operating practices					

Cl. No./	Project activity stage	Potential Impact	Proposed mitigation measures	Parameter to be monitored	Measurement & frequency	Institutional responsibility	Implementation schedule	Compliance Status
49	Inadequate periodic environmental monitoring.	Diminished ecological and social values.	Staff to receive training in environmental monitoring of project O & M activities	Training/awareness programs and mock drills for all relevant staff	Number of programs and per cent of staff covered – once each year	POWERGRID	Operation	
50	Equipment specifications and design parameters	Release of chemicals and gases in receptors (air, water, land)	Processes, equipment and systems using chlorofluorocarbons (CFCs) including halon, should be phased out and to be disposed of in a manner consistent with the requirements of the Govt.	Process, equipment and system design	Phase out schedule to be prepared in case still in use – once in a quarter	POWERGRID	Operation	
51	Transmission line maintenance	Exposure to electromagnetic interference	Transmission line design to comply with the limits of electromagnetic interference from overhead power lines	Required ground clearance (meters)	Ground clearance -once	POWERGRID	Operation	
52	Uncontrolled growth of vegetation	Fire hazard due to growth of tree/shrub /bamboo along RoW	Periodic pruning of vegetation to maintain requisite electrical clearance No use of herbicides/pesticides	Requisite clearance (meters)	Assessment in consultation with forest authorities- once a year (pre/post monsoon)	POWERGRID	Operation	
53	Noise related	Nuisance to neighbouring properties	Substations sited and designed to ensure noise will not be a nuisance	Noise levels {dB(A)}	Noise levels at boundary nearest to properties & consultation with affected parties if any - once	POWERGRID	Operation	

SECTION: 4 APPROACH AND METHODOLOGY ENGAGED FOR SOCIAL MONITORING OF THE PROJECT

Monitoring is a continuous process and it continues throughout the Project life cycle, starting from site selection to construction and maintenance stage. A Project Management Unit (PMU), headed by Executive Director (Corporate Planning), has been set up at headquarters to coordinate and implement all environment and social issues with the assistance of functional department like Environment & Social Management Deptt., Engineering etc. Apart from site managers reviewing progress on daily basis, regular project review meetings are held at least on monthly basis, chaired by the Executive Director of the region, wherein the social aspects of the projects are discussed and remedial measures taken, wherever required. The exceptions of these meetings is submitted to the Directors and Chairman & Managing Director (CMD).

POWERGRID has a separate monitoring department, which carries out real time monitoring of all parameters of project implementation including the environment and social issues. Such issues are discussed in detail during every quarter in the Project Review Meeting (PRM), which is chaired by Director (Projects). CMD also takes periodic review of project implementation.

SECTION: 5 DETAILS OF GRIEVANCE REDRESS COMMITTEE AND COMPLAINT RECEIVED AND ACTION TAKEN

Grievance Redress Mechanism (GRM) is an integral and important mechanism for addressing/resolving the concerns and grievances in a transparent and swift manner. Many minor concerns of peoples are addressed during public consultation process initiated at the beginning of the project. For handling grievance, Grievance Redress Committee (GRC) has been established both at the project/scheme level and at Corporate/HQ level. The site/project level GRCs constituted also include members from POWERGRID, Local Administration, Panchayat Members, Affected Persons representative and reputed persons from the society on nomination basis under the chairmanship of project head. The corporate level GRC functions under the chairmanship of Director (Projects) and includes one representative from corporate ESMD who is conversant with the environment & social issues.

Additionally, GRM process is inbuilt in the tree & crop compensation process, where affected persons are given a chance to place their grievances after issuance of notice by revenue officials on the basis of assessment of actual damages. Grievances received towards compensation are generally addressed in open forum and in the presence of many witnesses. Process of spot verification and random checking by the district collector also provides forum for raising the grievance towards any irregularity/complaint.

Many concerns/grievances from affected persons/public both of verbal and written nature have been recorded by Site Offices which are also regularly tracked for early resolution. However, it has been observed that most of them were minor in nature and were resolved instantly and amicably by Site Officials after discussion & deliberation with affected person/ in consultation of revenue/district officials. As of December 2020, 15 cases out of total 18 complaints are remain open/ in negotiation. Details of written & verbal complaints including court cases are presented below in **Table-6**.

Table- 6: Details of Court Cases and Complaints as of December 2020

S. N.	Name of the line	Location No.	Name of complainants	Date of complaints/ Court case	Main Issue of complaints	Status of complaint
A. Court Case						
1.	Mysore-Hiriyur 400kV	137/0 - 137/1	M/s Green World Development & Creations Pvt. Ltd., Mysore	11.11.17/ 01.02.18	Route diversion	Earlier, the matter was listed before the High Court on 01.02.18 for preliminary hearing, and on the request of the Petitioner the same was been adjourned. However, the petitioner has already accepted the compensation amount and has not pursued the matter with court further. Hence, the case may be treated as Resolved .
2.		21/1 & 21/3	Mr. Honnamma	06.08.18	Withhold of payment due ownership dispute	Matter pending in district court. Ownership issue yet to be resolved. Payment on hold.
3.		137/11	Mr. Gopale Gowda	13.08.18		
4.		6/2	Mr. P Thimmaiah	29.11.18		Resolved. Payment deposited in Court on 18.09.20
5.		65/1-65/2	Mr. Gurusidde Gowda	13.12.19	Withhold of payment due ownership dispute	Resolved. Payment deposited in Court on 20.11.20 Matter pending in district court. Ownership issue yet to be resolved. Payment on hold.
6.		65/3	Mr. Gangadhara	01.08.19		
7.		21/9-22/0	Mr. T. Shivamurthy	09.08.19		
8.		15/2-16/0	Mr. R. Rajappa	11.12.19		
9.		25/3-25/4	Mr. Guddegowda Bin Chandriah Ms. Gangamma kom Rangappa	29.11.19	Enhancement of Land and Tree Compensation	All compensation are made as per the rate fixed by Forest/ Horticulture/ Revenue authority. The case regarding enhancement of compensation is pending with the court.
10.		25/2-25/3	Mr. G Gururaja Mr. Honnappa Ms. Lakshamma Lokesh, Prabhakar	29.11.19		
11.		25/3-25/4	Mr. Devaraju D R Bin Rangappa Pandu D R Bin Rangappa	29.11.19		
12.		27/1-27/2-27/3	Ms. Bhimmamma	29.11.19		
B. Written Complaint						
13.		124/9-	Mr. Siddanayaka	09.07.18	Withhold of payment due	The matter being pursued in consultation with
14.		124/10				

	Mysore-Hiriyur 400kV				ownership dispute	Revenue Authority for settlement of ownership dispute. Payment on hold.
15.		23/0	Mr.Gowramma	04.10.18	Withhold of payment due ownership dispute	The matter being pursued in consultation with Revenue Authority for settlement of ownership dispute. Payment on hold.
16.		100/2-100/3	Chaluve Sheety	02.12.19		The matter being pursued in consultation with Revenue Authority for settlement of ownership dispute. Payment on hold.
17.		134/2&134/3	Mr. K. Gowda	18.12.19		
18.	Banas-kantha–Banaska-ntha 400 kV D/C	10/0 - 10/1	Sh. Ishwarbhai Nagabhai Rathod	24.06.20	Enhancement of compensation	POWERGRID submitted reply to land owner on. 29.07.20
C. Verbal Complaint						
<i>All verbal compliants are resolved and no new complaints reported during this reporting period.</i>						

SECTION: 6 CONCLUSION

From the above discussions, it is evident that all efforts have been made to minimize the social impacts associated with the project. POWERGRID endeavors to minimize the social impacts started right from the selection of land for the proposed substations by completely avoiding the socially sensitive areas. Fresh land was needed only for Bhadla substation. Accordingly, 130.91 acres of encroachment free Government land was secured for Bhadla substation through transfer without creating any adverse social issues or Project Affected persons (PAPs).

Similarly during construction of transmission lines, efforts were made to avoid damage to standing crops and trees. However, in unavoidable cases, compensation was paid at market rate for damage to standing crops. Accordingly, in the instant project till December, 2020, a total of 11,215 persons were issued notices for 1311.514 ha. of crop area/tree damaged for which total compensation of Rs. 421.54 million paid to affected farmers/land owners (Rs. 49.024 million during foundation and Rs. 44.776 million during erection & Rs.327.74 million during stringing). During reporting period of July-December 2020, compensation of Rs. 25.27 million has been paid out towards tree & crop damages to 978 cases. Further, POWERGRID has also paying land compensation for tower footing and RoW Corridor in compliance to Ministry of Power guidelines on RoW compensation dated 15th October, 2015 and subsequent govt. order/notification issued by Govt of Gujarat and Tamil Nadu for its implementation. Accordingly, as of December, 2020, an amount of Rs. 1599.317 million has been paid towards land compensation for tower base and RoW corridor in Karnataka and Gujarat.

In view of aforesaid, it may be noted that all possible measures have already been implemented to safeguard the interest of Project Affected Persons (PAPs). Besides, POWERGRID undertakes various need based Community Development Works under its Corporate Social Responsibility (CSR) activities such as skill development & capacity building, livelihood generation, healthcare, education, environment, plantation, sanitation,

drinking water and infrastructure developments like classrooms, roads, community centres etc. **(Annexure-IV)** in and around its areas of operations for socio-economic and integral development of areas and communities at large. Moreover, in long run the instant investment for infrastructure development shall have a positive impact on several socio-economic indicators in the nearby community and will ward off any temporary offset faced due to said project.

Dr. S.S. Singh
Chief General Manager (ESMD)

Annexure-1: Status of Action Plan for Safeguards under CSS

In order to achieve full compliance with ADB's SPS, 2009 under CSS, following agreed action plan is implemented by POWERGRID. The detailed compliance status of the same is as follows;

(i) Environment

Action Plan	Status
a) Assign environmental specialist(s) (staff or consultants) to each project for project implementation and monitoring during construction.	Dedicated environmental specialists have been assigned with the responsibility to coordinate, supervise & monitor the safeguard measures on project basis. To strengthen the manpower, two more environment specialists were recruited in 2017
b) Undertake stakeholder consultations with representation of women.	Completed as such information was already made part of IEARs/CPTDs.
c) Document disclosure and availability of project information in a timely manner and in a form and languages understandable to affected people.	All safeguard documents (IEAR/CPTD) including its update, if any, are regularly uploaded on POWERGRID's website. The Executive Summary of such reports are also translated in the local languages and disclosed at Panchayat Office/Site office as well as on website.
d) Document where EAMP requirements were not met and status of associated corrective actions in site visit reports by environmental specialists.	Regular inspection visit by assigned environmental specialists carried out and till date no major deviations worth reporting observed. Minor issues were rectified during visit itself in consultation with site in-charge.

(ii) Involuntary Resettlement

Action Plan	Status
Develop procedures on monitoring livelihood impacts of land acquisition.	As agreed no land has been secured involuntarily and all lands are secured on willing buyer willing seller basis on negotiated and agreed rate. The process of such negotiation included confirmation by seller that he is fully satisfied with the agreed rate and the process. As per agreed action, POWERGRID organized training for trainer programme on Livelihood Restoration in association with domain expert from ADB and World Bank in Jan.'18 wherein senior officials associated with safeguard implementation at various sites participated. Such topics have also been incorporated in the regular E & S training module to facilitate wider reach and acceptability.
a) Use recording and tracking systems in the Grievance Redress Mechanism.	Being complied. Two tiers GRC constituted and notified. Moreover, a centralized online portal for complaint has become operational which also include proper tracking and time bound action procedure.

Action Plan	Status
b) Conduct meaningful consultation with affected people.	<p>Being complied.</p> <p>Public consultation is an integral part of project cycle. However, more emphasis on dissemination of information through various modes have also been practiced.</p> <p>A total of 9 numbers of formal consultations and 10 informal group meetings have been conducted en-route of the proposed transmission lines. The issues/concerns raised by stakeholders during these formal/informal meetings were answered/ addressed instantaneously to the satisfaction of the participants. However, any major concerns during project implementation are being addressed through GRM as already explained at Section-8.</p>
c) Disclose monitoring reports, in a timely manner and in Hindi and English to the affected people.	<p>All approved semi-annual monitoring reports have already been disclosed on website. Further, as agreed executive summary of semi-annual monitoring report have also been disclosed in local languages (i.e. Hindi. Kannada & Telugu etc.)</p> <p>It is to inform that EAMP translated in Hindi is already available on website.</p>

(iii) Indigenous Peoples

Action Plan	Status
Provisions for acceptability actions with respect to safeguards of Indigenous Peoples are not applicable at this stage. While ESPP requires that a project affecting Indigenous Peoples prepare and implement a TPDP, there are currently no POWERGRID projects triggering Indigenous Peoples safeguards under implementation that are mature enough to assess.	<p>No impacts on IPs and hence actions with regard to IPs are not applicable in the instant case.</p> <p>However, to prepare POWERGRID for such issues two days training programme on Indigenous People for senior officials was organized in association with domain expert from ADB and World Bank in Jan.'18. Another such programme was also conducted from 11-13th December 2018 at PAL, Manesar.</p>

✚ In addition to above, as suggested by ADB during discussion website of POWERGRID has also been redesigned/ reoriented to ensure better accessibility/visibility of safeguard issues and can be accessed at following link:
<http://www.powergridindia.com/disclosure>

✚ As regard revision of ESPP it is to inform that as discussed during appraisal process “The Right to Fair Compensation and Transparency in Land Acquisition, Rehabilitation and Resettlement (Amendment) Bill, 2015” is still with Select Committee of Parliament of India and once cleared and notified the revision of ESPP shall be planned/undertaken.

Annexure -2: Sample Copy of Compensation Process


POWER GRID CORPORATION OF INDIA LIMITED
 (A Government of India Enterprise)
 (Region Name : SRTS - II)

Address : H. No. 2110, Near Bypass Road, Hirebidanur Village, Kasaba Hobli, GAURIBIDANUR-561209.

NOTICE UNDER THE ELECTRICITY ACT, 2003 READ WITH THE INDIAN TELEGRAPH ACT, 1885

Book No: **62**

Name of the Line/Section : 400KV, Pavagada - Devanhalli D/C TLC
 Sec. 68 Approval Ref. : No. 52 / 11 (PGCIL) / 2015-PSPA-II / 142-143 dated 23-02-2016



पवरग्रिड
POWERGRID
2489

Notice No: _____
 Date: 21/12/20

To:

Name: Pattalappa Father's/Husband's Name: Kempanna

Village: Juttanahalli PO: _____ Block/Tehsil: Devanhalli

Date: 21/12/2020 Pin: 562110 Mobile No: 9760921655

In accordance to section-164 of The Electricity Act, 2003, Ministry of Power, Govt. of India has conferred the power's of Telegraph Authority under Part - III of the Indian Telegraph Act, 1885 to Power Grid Corporation of India Ltd., (POWERGRID) vide Notification No. S.O. 1463(E) published in the Extraordinary Official Gazette of India On 24-12-2003. In exercise of such powers, notice is hereby given that the above mentioned line shall pass through your property/properties as detailed below. While all possible care will be taken to minimize the damage to standing crop and trees in the right of way (RoW), certain minimum unavoidable damages / felling of trees in Row may take place during construction of said line. All crop damage/tree felling shall be compensated as per the assessment of Revenue authority or any other competent authority as may be declared or decided by State Government/District administration.

Property Details :

Name of the Beneficiary (Owner/Tenant/Sharecropper): Y.K. patilappa Name of the Village: Juttanahalli
 Father's/Husband's Name: Kempanna Mandal / Tehsil / Circle: Kempanna
 Name of the District: Bangalore rural

Survey / Plot / Khasra No.: 9/1 Aadhaar No. of Beneficiary: 3076606 2352

Crop Details :

Sl. No	Location / Section	Name of the crop	Afflicted Crop Area (sq. m.)*	Activity Fdn./Erec./Strg./Other	Remarks
1	8 1/2				F.D.

Tree Details * :

Sl. No	Location/ Section	Name of the Tree Species	Approx. Age(Yr.)	Girth(1m above ground level)	Height (in Meter)	Nos.*	Activity Fdn./Erec./ Strg./Other	Remarks

*In case more trees, table with such details may be annexed

Acknowledgement

(Signature with name)
 Owner/Beneficiary/Representatives.

For Power Grid Corporation of India Ltd.,

(Signature of Issuing Official)
 Name /Seal

(Countersigned by Executive)
 Name /Seal

Copy to : Local Concerned Revenue Official
 * Based on preliminary assessment, However, compensation shall be paid as per actual crop damaged no. of trees felled.

Book No. _____

Notice No. _____

This is to certify that the damaged crops / felled trees as per enclosed list have been handed over by POWERGRID to you / your authorized representative.

(Signature with name)
 Owner/Beneficiary/Representative.


For Power Grid Corporation of India Ltd.,

(Signature of Issuing Official)
 Name /Seal

(Countersigned by Executive)
 Name /Seal

Notice to Land owner in 400 KV Pavagada- Devanhally line

ಗ್ರಾಮ:ಜುಟ್ಟನಹಳ್ಳಿ ಹೋಬಳಿ: ಕುಂದಗಾ ತಾಲ್ಲೂಕು: ದೇವನಹಳ್ಳಿ ಜಿಲ್ಲೆ: ಬೆಂಗಳೂರು ಗ್ರಾಮಾಂತರ
 ದಿನಾಂಕ: 9/1, 9/2ಎ ರಸ್ತೆ ಪಕ್ಕದ ಗ್ರಿಡ್ ಅಧಿಕ ಮಧ್ಯಸ್ಥಾಪನಾ ತಂತಿ ಹಾಡುವಾಗಲಾದ ಟವರ್ ಜಾಗವು ಜುಟಿ ಅಕ್ರೆ ಸೈಟ್

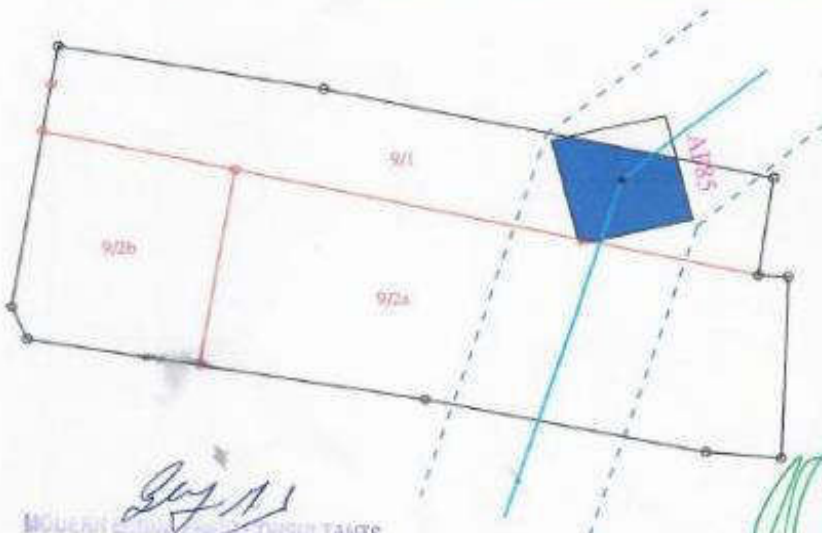

[Signature]
 MODERN ENGINEERING CONSULTANTS
 A.S. Complex, Opp. Tumkur University
 B.H.Road, Tumkur-572 102

ವ್ಯಾಕ್ಟ್ ಸಂಖ್ಯೆ	ಸ.ಸಂ	ಬೆಂಚ್‌ಮಾರ್ಕ್ ಸಂಖ್ಯೆ	ಟ್ರಸ್ಟ್ ಅಥವಾ ಟೀಲರ್ ಮೆಮ್ಬರ್ ಎಕ್ಸ್‌ಟೆಂಷನ್	ಪಂಚಾಯತರ ಟವರು/ ಅಲ್.ಟಿ.ಸಿ.ಎಂ.ಎಲ್ ಟವರು	ಪೂರ್ವ ಗ್ರಿಡ್ ಅಧಿಕ ಮಧ್ಯಸ್ಥಾಪನಾ ತಂತಿ ಹಾಡುವಾಗಲಾದ ಟವರ್ ಜಾಗದ ವಿವರಣೆ				ಫಲಿತಾಂಶ	
					ಒಟ್ಟು	ಅಧಿಕ	ತಂತಿ	ಒಟ್ಟು		
					ಎ-ಗಾ	ಬಿ-ಗಾ	ಸಿ-ಗಾ	ಡಿ-ಗಾ		
	9/1	APSS	DD+25 with RC-5	ಪ್ರ.ಶ.ಪರಿಮಾಪ್ತ-ಶಿ.ಕೆಂಪ್ಪು (0-10.00) ಸುರಕ್ಷಿತ ಟವರ್ ಲೇ.ಎಂ.ಎಲ್ (1-100.00)	0.07.657	---	---	0-07.657	ಉಪ್ಪಿ	774.775 Sqmts
	9/2A	APSS	DD+25 with RC-5	ಸಂಪನ್ಮೂಲ-ರೇ.ಸಾರಾಂಯಣ್ಣ (0-30.00)	0.0.035	---	---	0-0.035	ಉಪ್ಪಿ	3.39 Sqmts

ಈ ಮೇಲ್ಕಂಡ ಸ್ಥಳಿಯನ್ನು ಮಾನ್ಯ ಇಲಾಖಾಧಿಕಾರಿ ರವರು ಅರೇಜ್ ಸಂಖ್ಯೆ /ಸಂ.ಎಡಿಎಂ.ಎಂಎಸ್.ಸಿ.ಆರ್/173/2019-20 ದಿನಾಂಕ:20-11-2019 ಹಾಗೂ ಭೂದಾಖಲೆಗಳ ಉಪ ನಿರ್ದೇಶಕರ ಸಂಖ್ಯೆಎಂ.ಡಿ/ಭೂ.ನಿಯೋಜನೆ/42/2018-19 ದಿನಾಂಕ:26-11-2019 ರ ಆದೇಶದ ಮೇರೆಗೆ ಪೂರ್ವ ಗ್ರಿಡ್ ಕಾರ್ಪೋರೇಷನ್ ಅಕ್ರೆ ಇಂಡಿಯಾ ರವರ ಸಿಬ್ಬಂದಿ ಪರಿಶೀಲಿಸಿ ಪರಿಶೀಲಿಸಿದಂತೆ ಪೂರ್ವ ಗ್ರಿಡ್ ಇನ್‌ಫ್ರಾಸ್ಟ್ರಕ್ಚರ್ ಮತ್ತು ರಾಜಸ್ವಲ್ಪ ವಿರೀಕ್ಷಿಸಿ ಮತ್ತು ಗ್ರಾಮಾಧಿಕಾರಿ ರವರ ಅಲ್.ಟಿ.ಸಿ.ಎಂ.ಎಲ್ ಟವರು ಸಮಗ್ರವಾಗಿ ಇಂಟಿ ಅಕ್ರೆ ಮಾಡಿ ನಕ್ಷೆ ತಯಾರಿಸಿದೆ.

[Signatures]
 ಇ.ಆ.ನಂ. / M. ANANTHESWARA
 ಮುಖ್ಯಸ್ಥಾಧಿಕಾರಿ / Chief Manager
 ಇಲಾಖೆ, ಎ.ಇ.ಸಿ. / POWERGRID, ILC
 ದೇವನಹಳ್ಳಿ ತಾಲ್ಲೂಕು
 ದಿನಾಂಕ: 12/3/2020

checked by
[Signature]
 ಶ್ರೀ. ಎಸ್.ಎಂ
 ಭೂಮಾಪಕರು

[Signature]
 ತನುಕುಮಾರ್
 ದೇವನಹಳ್ಳಿ ತಾಲ್ಲೂಕು

[Signature]
 ಭೂದಾಖಲೆಗಳ ಸಹಾಯಕ ನಿರ್ದೇಶಕರು
 ದೇವನಹಳ್ಳಿ ತಾಲ್ಲೂಕು
 ದೇವನಹಳ್ಳಿ

[Signature]
 ರಾಜ್ಯ ನಕ್ಷಣಾ
 ಕುಂದಗಾ ಹೋಬಳಿ
 ದೇವನಹಳ್ಳಿ ತಾಲ್ಲೂಕು

Assessment/Evaluation of Compensation by Revenue Department for 400 KV Pavgada- Devanhally line

PG
 NAME (P.A.A)
 POWERGRID CORPORATION OF INDIA LTD.
 BELUR, BANGALORE

Sub: Authorization of all payments through Electronic Fund transfer system/RTGS/NEFT

We hereby authorize POWERGRID to disburse all our payments through electronic fund transfer system/RTGS/NEFT.

The details for facilitating the payments are given below:-

Name of the Beneficiary	PATALAPPA YK
Permanent Account Number (PAN)	DHMPP2105B
Correspondence Address With Postal Pin	.
Telephone No.	
Landline	
Mobile	7760901665
Current Account	
Contact person	PATALAPPA YK
Bank Details for one-time payment	
Name of Bank	STATE BANK OF MYSORE
Address of Branch	DEVANAHALLI
Account No.	64208389517
Type of Account (Saving/Current)	SAVING
RESIDENT CODE	SBMY0040032


I/We, hereby, declare that particulars given above are correct and complete and I will be the sole responsible if the transaction is delayed or credit is not effected due to incorrect information.



Y.K. Jaganappa
 Authorized Signatory/Payer
 Name

Note: Please enclose one copy of original photo copy of Bank Pass Book and copy of photo ID for E-Payment.

Signature of POWERGRID Executive with Name Designation & Official Seal

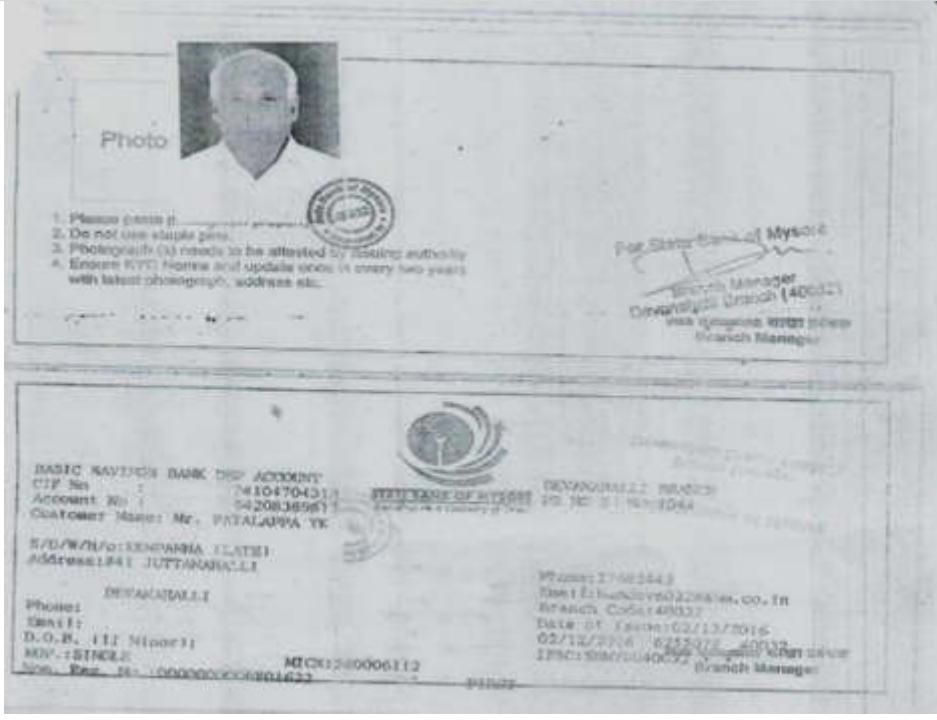

Payment to Land owner

Annexure -3 : E & S Training Programme conducted online during reporting period

Training Program on “Managing Right of Way (ROW) and Obtaining Statutory Clearances for Projects”				
Date	10.00-10.15	10.15-11.30	11.30-11.40	11.40-13.00
06.08.20	Inauguration	Environmental laws of India viz-a-viz Forest & Wildlife Clearance <i>(Dr. S.S. Singh, CGM (ESMD), CC)</i>	Break	Forest/ Wildlife Clearance <i>(Dr. S.S. Singh, CGM (ESMD), CC)</i>
Date	10.00-11.15	11.15 - 11.30	11.30 -12.45	12.45-13.00
07.08.20	RoW Compensation Vis-à-vis new development in the ambit of existing laws and RoW (Process & Compensation) Guidelines <i>(Dr. R.K. Srivastava, Ex. CGM (I/c) ESMD & Consultant)</i>	Break	The Right to Fair compensation and Transparency in Land Acquisition, Rehabilitation and Resettlement Act 2013 & Direct Purchase <i>(Dr. R.K. Srivastava, Ex. CGM (I/c) ESMD & Consultant)</i>	Feedback

Training Program on Overview of Forest (Conservation) Act, 1980 with recent developments & insight of forest proposal”				
Date	10:00-10:10	10:10 – 11:10	11:10-12:25	12:25-01:00
16.10.20	Inauguration	RoW Compensation Vis-à-vis new development in the ambit of existing laws and RoW (Process & Compensation) Guidelines <i>(Dr. R.K. Srivastava, Ex. CGM (I/c) ESMD & Consultant)</i>	Approval under Forest (Conservation) Act 1980 & Wildlife Clearance under Wild Life (Protection) Act, 1972 <i>(Dr. S.S. Singh, CGM (ESMD), CC)</i>	Submission of proposal under Forest (Conservation) Act 1980 <i>(Suvendu Kumar Kar, Chief Mgr. (ESMD))</i>

Annexure - 4: Completed Community Centre at Madikeri under CSR



Appendix-1 : Photographs related Covid- 19 Specific Measures Implemented at Site



COVID testing of Worker




Distribution of Food relief to Workers



Thermal Scanning & Use of PPEs



Sanitization of Equipments & Construction Materials


 ಸರ್ಕಾರ ಕರ್ನಾಟಕ
 ಸರ್ಕಾರದ ಆಸ್ಪತ್ರೆ, ಗೌರಿಬಿದಾನುರ: ಚಿಕ್ಕಬಳ್ಳಾಪುರ ಜಿಲ್ಲೆ-561208
 E-mail: amoghghar123@gmail.com


“Designated Covid Health Center DCHC Gauribidanur”

“Discharge Summary”

Name:- *Nageshwar Rao s/o Laxhmanrao Rao*
 Age:- *35yrs*
 Sex:- *male*
 Address *Gauribidanur*
 Date of Testing:- *12/10/20*
 SRF ID:- *2963000128899*
 Treatment Given:- TAB-HCQ 400MG BD (DAY-1)
 TAB-HCQ 200MG BD (DAY-2-5)
 TAB- AZITHROMYCIN 500MG OD*5DAYS
 TAB- OSELTAMIVIR 75MG BD*5DAYS
 TAB-VITC 500MG BD*5DAYS
 TAB- ZINC 50MG OD*5DAYS
 Cap-Omeprazole BD*5DAYS

Discharge Date:- *22/10/20*

Advise:- 1) Strict Home isolation for 7 Days:
 2) Report ILI/SARI Symptoms as explained,
 3) Contact Hospital OR Apathmitra Help Line No-14410,
 4) Regular Healthy Diet/ Maintain personal hygiene


 Senior Specialist
 General Hospital Gauribidanur

Discharge Summary & COVID test report of Worker diagnosed with COVID symptoms

Government Of  Karnataka
 General Hospital Gauribidanur Chikkaballapur(D) -561208
 phone-08155-236550 E-mail: amoghghar123@gmail.com

Date:- *28/10/20*

COVID-19 TEST REPORT

Sl. No	SRF ID	Patient Name	Address	Age	Sex	Specimen type	Date of sample tested	Result
<i>383</i>	<i>2963000128899</i>	<i>Nageshwar Rao</i>	<i>Gauribidanur</i>	<i>35</i>	<i>M</i>	<i>RT-PCR</i>	<i>28/10/20</i>	<i>Negative</i>

Lab Technician
 General Hospital, Gauribidanur
 Administrative Medical Officer
GENERAL HOSPITAL
GAURIBIDANUR-561208,
 Chikkaballapur District.