

Encl. 7

**POWER GRID CORPORATION
OF INDIA LIMITED**
[A Government of India Enterprise]
SALT LAKE OFFICE, KOLKATA



FE-498, Sector-III, Salt Lake City, Kolkata : 700 106
Telephone : 359-6019, 359-6026, 337-4059 FAX : 337-3281, E-mail : ertskol@vsnl.net

Ref.No. E:CL:SG-LA 2161

Dated : 31.08.2002

To
The Principal Secretary, Power,
Govt. of West Bengal,
New Secretariat Building,
Kolkata

Sub: Requisition for Acquisition of Land for Construction of 400/220 KV Substation at Subhashgram, Distt. 24-Parganas (South) under supplementary scheme for transmission system associated with Tala HE Project, East-North interconnector and Northern Region transmission system.

Dear Sir,

Your goodself may kindly aware that Power Grid Corporation of India Limited undertake a scheme under the name of "Supplementary Scheme for Transmission System" associated with Tala HE Project for evacuation of power from Bhutan. Under this scheme there is a proposal for construction of one 400/220 KV Substation at Subhashgram. We are submitting herewith a requisition for acquiring 42.0 Acres of land at Subhashgram, Mouza Garia no.6. The requisite documents as well as drawings, Mouza maps etc. are being enclosed herewith for ready references.

Your goodself may kindly forward the case to District Magistrate, South 24-Parganas, Alipore for further necessary action.

Thanking you,

Yours faithfully,
For & on behalf of
Power Grid Corporation of India Ltd.


M. M. BAIDYA
Chief Manager
Power Grid Corpn. of India Ltd.
FE-498, Salt Lake City, Cal-91.

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड

(भारत सरकार का उद्यम)

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)



पावरग्रिड

एड. 5-498, सेक्टर - III, साहू लेक सिटी, कलकत्ता - 700 106

Tel: 498, Sector - III, Salt Lake City, Kolkata: 700 106.

Telephone: 2332 0019, 2339 6026, 2337 4039 Fax: 2337 3201, Email: gpc@powergrid.net, Gcm: "NATGRID"

Ref. No. E/CL/SG/Site Leveling/ 4035

Date : 03/05/2004

To
The Sub-Divisional Officer,
Block Land & Land Reforms Office, Baruipur,
South 24-Parganas.

Dear Sir,

Received
Shri. S. K. Das
2004

Sub: Site Leveling work at 400/220 kV Subhashgram Sub-station

You may kindly aware that Power Grid Corporation of India Limited, a Public Sector Enterprise under the Ministry of Power, Govt. of India is engaged in construction of 400/220 kV Sub-station at Subhashgram at Mouja - Garia, J.L. No.6, P.S. - Baruipur, Distt. - South 24-Parganas. The Site Leveling work at the above site is taken up by M/s. Avoy Charan Bakshi, Disari Commercial Complex, P.O. + P.S - Mahishadal, Dist. - Purba Medinipur, PIN - 721628(WB) vide Award Letter No. ER/PAT/C&M/LOA-412/18 dated 14.04.2004. In the process, M/s. Bakshi is collecting the excavated earth from various locations within 2 km. periphery of the site in consultation/agreement with the land owners. It is understood from our site that your representative Md. Idrish Ali Khan, Amin and Sh. Gopal Chatterjee, Amin have visited the area under Mouja - Auliapur and Akra - Mirzapur from where gang of M/s. Bakshi is under process of excavation and have given the directive to stop the work till the election of 2004.

You may also kindly be aware that the aforesaid project is a part of Transmission System associated with Tala Hydro Electric Power Project, Bhutan. As per the agreement between Royal Govt. of Bhutan and Govt. of India the entire power of Tala HEP is to be supplied to India. The evacuation system within the territory of Bhutan is to be constructed by Tala HEP while the Transmission System within Indian territory is to be planned and constructed by POWERGRID. Subhashgram Sub-station is one of the major supply points for West Bengal under this prestigious international fame project and hence it has got additional importance as time bound project. The entire project is proposed to be commissioned by May-2005.

Contd.... P/2.


पता: सी - 9, कुतुब इंस्टिट्यूशनल एरिया, कलकत्ता नगर, नई दिल्ली - 110016
Office: B-9, Qutab Institutional Area, Katwara Sarai, New Delhi - 110016
S. O. 11 - 26560112, 26560115, 26560193, 26561892, FAX: 011-26560039, Gcm: "NATGRID"
आला: "कलकत्ता" कार्यालय - 2, सेक्टर - 29, गुगायन - 122 001, हरियाणा
पता: "साहू लेक सिटी" प्लॉट नं. 02, सेक्टर - 29, गुगायन - 122001 (हरियाणा)
फोन: 0124-2571700 to 719, FAX: 0124-2571760, 2571848, Gcm: "NATGRID"

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड

(भारत सरकार का उद्यम)

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)



पावरग्रिड

एक.ड-498, रोड -III, सॉल्ट लेक सिटी, कलकत्ता -700 106

PE - 498, Sector - III, Salt Lake City, Kolkata : 700 106


Telephone : 2359 6019, 2359 6026, 2337 4059 Fax : 2337 3281, E-mail : tcskol@vsnl.net, Gram: "NATGRID"

:: 2 ::


In view of above, we have planned and framed our schedule to complete the leveling work before monsoon i.e. 15th of June '04 and hence we have got hardly any time to spare for any eventuality without delaying the project schedule. If the Leveling work is delayed beyond 15th June '04, we may land into monsoon and there will be slippage of the whole project work for one year. The effect of delay will lead to the enhancement of the project cost and will have a serious effect on tariff structure. This may also lead to a serious effect on the bilateral agreement between Royal Govt. of Bhutan and Govt. of India.

Under the circumstances, you may kindly look into the serious pressure prevailed upon POWERGRID to perform the job within the time schedule and permit us to start the job with immediate effect.

Thanking you,

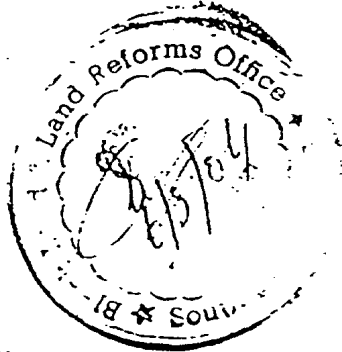

Yours truly,


(M.M. Baidya) 13-06-04
Dy. General Manager

Copy to:-

- 1) ADM, DL & LRO,
New Treasury Building,
Alipore, Kolkata-27.
- 2) The B.L.R.O.,
Block Land & Land Reforms Office, Baruaipur,
South 24-Parganas.

For kind information and
necessary action please.

01c

मुख्यालय: सी-9, इण्डिया इन्स्टिट्यूशनल एरिया, कलकत्ता सराव, नई दिल्ली - 110016
HQ Office: B-9, Quail Institutional Area, Katwana Sarai, New Delhi - 110016
ABN : 011 - 26560112, 26560115, 26560193, 26564892, FAX : 011-26562259, Gram: "NATGRID"
उप-मुख्यालय "सोदागिनी" ब्लॉक में -2, सेक्टर -29, गुडगाँव - 122 001, हरियाणा
Corporate Office: "Saudamini" Plot No.02, Sector-29, Gurgaon-122001 (Haryana)
ABN : 0124-2571700 to 719, FAX : 0124-2571760, 2571848, Gram: "NATGRID"

- 55 -

Annex-II

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड

(भारत सरकार का उद्यम)

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)



पावरग्रिड

एक 5-498, सेक्टर -III, साल्ट लेक सिटी, कलकत्ता -700 106


EE - 498, Sector - III, Salt Lake City, Kolkata : 700 106

Telephone : 2359 6019, 2359 6026, 2337 4059 Fax : 2337 3281, E-mail : pgrid@psnl.net, Gram : "NATGRID"

Ref.No. E/CL/SG/Site Leveling/4038

Date : 05.05.2004

To
The Sub-Divisional ~~Officer~~,
~~Block~~ Land & Land Reforms Officer, Baruipur,
South 24-Parganas.

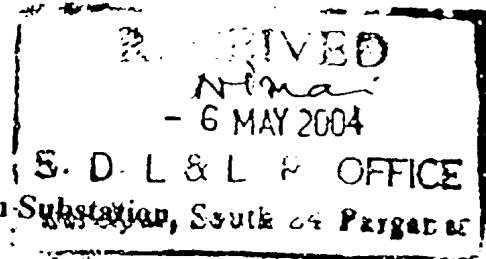

Sub : Site Leveling work at 400/220 KV Subhashgram Substation, South 24 Parganas


Dear Sir,

In continuation to our earlier letter ref. no. E/CL/SG/Site Leveling/4035 dtd. 03.05.2004 in connection with the subject matter, we would further like to intimate that site leveling work at above site is proposed to be done by the borrowed earth within 4 Km. periphery i.e. from Mouza South Garia, Akna-Mirzapur, Auliapur, etc. The required quantity of the borrowed earth is expected to be to the tune of 2,50,000 Cu.Mtr.

M/s. Abhay Charan Bakshi and associates, the Civil Engineering Contractor is engaged for the job and they are supposed to pay the royalty charges, if any, for the borrowed earth. As a client Power Grid Corporation of India Ltd. will ensure that the royalty is paid by the contractor in due course of time.

We hope that we have clarified our position and your queries on the subject matter and hence we would like to request your kindness to permit us for starting the work without any further delay.

Thanking you,

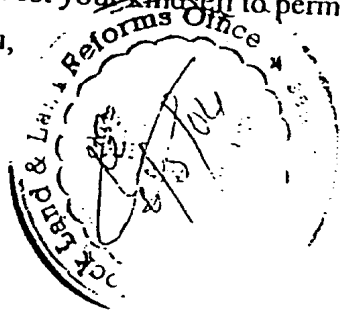

Yours faithfully,

(Signature)
(M.M. BAIDYA)

Dy.General Manager, Kolkata

Copy to :-

- 1) ADM, DL & LRO, New Treasury Bldg., Alipore, Kolkata - 27.
- 2) The B.L.R.O., Block Land & Land Reforms Office, Baruipur, South 24-Parganas.

| For kind inf. and necessary
| action please.
|

For Kind information of :

- 1. ED(ER), POWERGRID, Patna.
- 2. AGM(Constn.), POWERGRID, Patna.

संयुक्त कार्यालय : 9, कुर्च इन्स्टीट्यूशनल एरिया, कलकत्ता-700 106
Regd. Office: B-9, Qutab Institutional Area, Katwani Sarai, New Delhi - 110016
EPABX : 011 - 26560112, 26560115, 26560193, 26564892, FAX : 011 - 26560113
राष्ट्रीय कार्यालय "सौदामिनी" ब्लॉक नं-2, सेक्टर-29, गुंगुम - 122 001, दिल्ली
Corporate Office: "Saudamini" Plot No.02, Sector-29, Gurgaon-122 001 (Haryana)
EPABX : 0124-2571700 to 719, FAX : 0124-2571760, 2571848, Gram : "NATGRID"

(Signature)

From : Ashroy Charan Bakshi
Power Grid Corpn. Site off
South Garia

24 Parganas (South)

13th. May, 2004.

The Officer-in-Charge,
Baruipore Police Station,
Baruipore,
24-Parganas (South)

Dear Sir,

This is to draw your attention to the tremendous problem and threat that we are facing from the local anti-social elements while carrying out our work of earth excavation for land filling work for Power Grid Corporation India Limited.


It may be mentioned here that we are working as land development agency for Power Grid Corporation of India. On Wednesday, the 12th. of May while we were excavating earth in South Garia Moza at around 9.45 in the evening, some unknown miscreants attacked our vehicles, equipments and physically manhandled our operator and helper besides causing extensive damage to our vehicles and equipments ~~apparently~~ without any provocation from our side. The whole operation was carried out under the

cover of darkness and as such our workmen, particularly, who were beaten up could not recognise the miscreants.

Since we feel that the safety and security of our entire workforce stationed at site is in danger, we request you to kindly investigate the matter and protect our workmen from further recurrence of the incidence.

This may please be treated as an F.O.R.
Thanking you,

yours faithfully,
For ABHOY CHARAN BAKSHI.


(C. D. DAS GUPTA)



Amney-

Telephone : 2359 6019, 2359 6026, 2337 4059 Fax : 2337 3281, E-mail : certkol@vsnl.net, Gram : "NATGRID"
 FE - 498, Sector - III, Salt Lake City, Kolkata : 700 106

Ref.No. E/CL/SG/General / 4093

Date : 02.06.2004

To
 The Officer-in-Charge,
 Baruipur Police Station,
 Baruipur,
 Dist. 24-Parganas(South).

Sub : Request for administrative action - reg.

Dear Sir,

This is to draw your kind attention towards GDE no. 922 dtd. 13.05.2004 lodged by our Site leveling contractor M/s. Abhoy Charan Bakshi, C/o Power Grid Corporation of India Ltd., Site Office, South Garia, 24 Parganas (South). In that diary they have already lodged the complain of facing hindrance from local miscreants against performing the Site Leveling Work. In this regard you may please be aware that the construction work of 400/220 kV Sub-station and Transmission Line is undertaken by POWERGRID as priority work against the agreement signed between Royal Govt. of Bhutan and Govt. of India for evacuation of power generated from TALA HEP. As such we are under pressure to complete the job before commissioning of TALA HEP to honour the agreement mentioned as above.

Hence it is requested to take the appropriate action so that our work could progress smoothly. Your kind co-operation in this regard is highly solicited.

Thanking you,

ENCL: COPY OF GDE NO. 922
 dtd. 13.05.2004

Yours faithfully,

(Signature)
 (I. Basu)

Manager(I/c-HR), Kolkata

etc

59

M/S. ABHOY CHARAN BAKSHI

1st Class Govt. Contractors & General Order Suppliers

Regd. Office :

DISARI COMMERCIAL COMPLEX
P.O. + P.S. -- MAHISHADAL
DIST. -- PURBA MEDINIPUR
PIN -- 721628 (W.B.), INDIA.
Phone -- (03224) 240-600/240-603/
240-809/240-660
FAX - (03224) 240-660

Haldia Regional Office :

P.O. -- KHANJANCHAK
DURGACHAK, HALDIA,
DIST. -- PURBA MEDINIPUR
PIN -- 721602 (W.B.), INDIA.
Phone -- (03224) 275-167/275-522/
275-523/275-524/275-525
FAX - (03224) 275525

Ref. No. ACB/PAC/IL/KC-04/2004.

Date 18th July, 2004

The Dy. General Manager,
Power Grid Corporation of India Limited,
FE - 498, Sector - III,
Salt Lake City,
Kolkata.

Dear Sir,

This is to bring to your notice that on Saturday, the 17th July, 2004, at around 7.30 in the evening, some unknown miscreants armed with fire arms and daggers entered the site. They reportedly had an altercation with few local men who were already in the site on matters not known to us. Our men who were busy inside the camp complex suddenly heard the sound of shots fired from firearms. Surprised by the turn of events and scared for their own safety our men got panic stricken and somehow managed to get out of the site and ran for safer place.

It may be recalled here that in the recent past our men were manhandled by some unknown miscreants and the matter was brought to the notice of the Baruipur Police Station through an FIR lodged with them under intimation to you.

Under the above circumstances, we feel cocerned about the safety of our men and machinery present at site for execution of the work and are now forced to withdraw our manpower from site. However, the machineries for execution of further work and other properties belonging to us are lying at site still.


It may be mentioned here that it is a regular practice for local people to pass through the site as a short cut for reaching Champahati Road or Aoulia village or for a stroll particularly during the evening hours over which we have no control.


We now request you to take appropriate measures to stop incidence of violence and intimidation so that the work can progress in a peaceful atmosphere.

We shall be looking forward to hear from you on the subject as early as possible.

Thanking you,

Yours faithfully,
ABHOY CHARAN BAKSHI


(D. DAS GUPTA)



Annex

Ref.No. E/CL/SG/General/4167

Date : 20.07.2004

To
The Officer-in-Charge,
Baruipur Police Station,
Baruipur,
Dist. 24-Parganas(South).

Sub : Request for administrative action - reg.


Dear Sir,

It has been brought to your notice by our Site Levelling Contractor, M/s. A.C. Bakshi vide letter no.ACB/PGCII/GC-04/2004 dated 18th July 2004 (copy of letter enclosed), that on 17th evening some unknown miscreants with fire arms and daggers entered within the periphery of POWERGRID 400/220 kV Subhasgram Substation Site at Mouja: Garia, J.L. No.6, P.S. Baruipur, Dist. South 24-Parganas and have fought over among themselves for the reasons which is best known to them. However, our contractor's employees who were present at the time of incident could not identify any of the miscreants.

This kind of incident is absolutely undesirable and recurrence of any such incident shall force the contractor to stop the work which in turn affect the progress of the project. Hence you are requested to take appropriate action to bar such hooliganism at our site.

Your kind cooperation in this respect is highly solicited.

Thanking you,

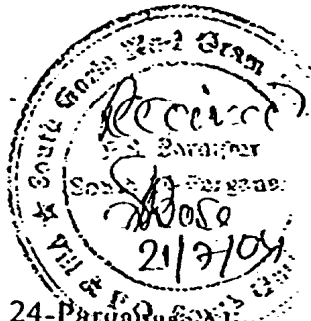

Yours faithfully,

[Signature]

(I. Basu)

Manager(I/C-III)/Kolkata

Copy to :

1. ADM & DLLRO, South 24-Parganas, Alipore.
2. Supdt. of Police, South 24-Parganas, Alipore.
3. S.D.O., Baruipore, South 24 - Parganas.
4. B.D.O., Baruipore, South 24-Parganas.
5. Sabhadhipati, Panchayet Samity, Baruipore.
6. Panchayet Pradhan, South Garia.

Received
Contents not verified
Date 20/7/04

[Handwritten notes and signatures]
Baruipur Panchayet Samity
South 24 Parganas

Regd. Office : B-9, Qutab Institutional Area, Katwaria Sarai, New Delhi - 110016
EPABX : 011 - 26560112, 26560115, 26560193, 26564892, FAX : 011-26560039, Gram: "NATGRID"
Corporate Office: "Saudamini" Plot No.02, Sector-29, Gurgaon-122001 (Haryana)
EPABX : 0124-2571700 to 719, FAX : 0124-2571760, 2571848, Gram: "NATGRID"

over this Baruipur P.S.
Case NO. - 169/04 dt. 25/7/04
u/s - 326/307/34 CrPc
25/7 Arms Act
has been started



[Handwritten notes and signatures]
20/7/04

Minutes of the meeting held at the Office of Baruipur Panchayat Samity, Baruipur on 22.6.01 at 11 a.m. in connection with prevention of unauthorized extraction of earth.

Sri Jaswaid Akhtar, ADM & DLRO, South 24-Parganas took the chair. Sri Baidyanath Mondal, ADM (L A) was also present.

List of participants : Enclosed separately.

Sri Jawaid Akhtar, ADM & DLRO explained the purpose of the meeting and reiterated the decision of the District Administration to prevent all unauthorized and illegal earth extraction activities.

Representative of Krishaksabha, Sabhapati, Baruipur Panchayat Samity raised the issue of unauthorized earth excavation in the Mouzas of South Garia, Srirampur etc. by local youth without any valid permission from the Land Reforms Authority. As a result of unplanned earth excavation, the cultivable lands have been badly damaged. Towers of WBSEB, Embankment of the Bindakhali Canals and other vital installations have been endangered. Several complaints made to Police Officials yielded no result. The contractors of Power Grid Corporation have entered into agreement with local youths for supply of earth to them without verifying the source from where the youths will supply the earth. They have also not bothered to check whether the supplying agencies of the contractors have taken any permission from the competent authorities. The matter has been viewed very seriously. After detailed discussion it has been decided as follows :

1. The Officials of Power Grid Corporation and the contractors will immediately meet Sabhapati, Baruipur Panchayat Samity and place their requirement of earth which is nearly 30, 000 cubic meter at present. The Panchayat Samity will take urgent necessary action for arranging the same after observing legal formalities.
2. The Police authorities will be more vigilant and careful in future. They will see that no earth excavation activity takes place within Baruipur P.S. without proper permission from the Land Reform Authorities. He will also check the papers of the trucks carrying earth. If the trucks are found carrying unauthorized earth he will proceed against them under Motor Vehicles & other appropriate Acts besides Minor Mineral Act. The DLRO, Baruipur will lodge FIR and provide necessary help and cooperation to the police authority as and when required.
3. The present site from where the contractors of Power Grid Corporation was unauthorisedly and illegally cutting the earth will remain closed.
4. The matter of awarding compensations to the affected persons will be examined by the Panchayat Samity and suitable suggestions will be given by them.
5. DLRO, Baruipur will assess the amount that has already become due to the Government in respect of excavation of earth for Power Grid Corpn and take necessary action for realization of the same. He will also take necessary legal action against the concerned persons for unauthorized extraction of earth and illegal conversion and changing the nature and character of land.

The meeting ended with vote of thanks to and from the Chair.

P. L. C. A.
28/6/01
ADM & DL & LRO,
South 24-Parganas.

Memo. No. 16176/200 6.2.29/701

Dated 22/06/2004

Copy forwarded for kind information to:

1. The District Magistrate, South 24 Parganas.
2. The Superintendent of Police, South 24 Parganas.
3. The Additional District Magistrate (L.A.), South 24 Parganas.

4. Shri / Smt. M. M. Paidya, DGM..... for information and taking necessary
power Grid Corpn.
action.

J. S. Datta
For Additional District Magistrate &
District Land & Land Reforms Officer,
South 24 Parganas,
New Treasury Buildings (8th floor),
Alipore, Kolkata - 700 027.

63

#

Alternatives presently available for commencement of
Levelling & Filling works at 400 kV Subhasgram Sub-station

Alternative: I

Government vested land for which case was initiated in the month of June-04 and approved by ADM (DL&LRO) during end November-04, but cancelled in 1st week of December-04, may be revived and possession given to POWERGRID immediately.

Further, District Administration to make all out efforts to hand over balance 25 (twenty-five) bighas of vested land and hand over to POWERGRID within a fortnight.

Alternative: II

Keeping in view that six months times has been wasted in processing of vested land, POWERGRID may be permitted to commence excavation work immediately after case for conversion of land status is submitted to R.I. i.e., without waiting for formal permission.

It goes without saying that royalty and other government dues, as assessed by the relevant authorities, shall be paid as soon as the demand is raised.

The District Administration may further be advised to ensure that there are no hindrances created by any third party after POWERGRID has obtained written consent from the specific land owners.

Proceeding of the meeting held on 09.12.2004 at 11-00 a.m. at the office of the S.D.L&L.R.O, Baruipur, South 24-Parganas in connection with excavation of earth by Power Grid Development Corporation Ltd. an Undertaking of Govt. of India

The meeting started at 11.00 a.m. with the introduction of all the authorities present in the meeting. A.D.M and D.L&L.R.O, South 24-Parganas took the chair to preside over the meeting. The following members of this District, the Panchayat Functionaries and the officials of P.G.C.L attended the meeting.

1. Mr. Nawaid Akhtar, A.D.M and D.L&L.R.O, South 24-Parganas.
2. Mr. Arjun Kumar Ghosh, S.D.L&L.R.O, Baruipur.
3. Mrs. Mukti Majumder, Savapati, Panchayat Samity, Baruipur.
4. Mr. Amresh Saha, S.R.O-II & C/C, Brick Field, S.D.L&L.R.O.
5. Mr. Chitta Ranjan Paul, S.D.L&L.R.O, Baruipur.
6. Mr. Biswanath Pal, Jt. P.D.C, Baruipur.
7. Mr. Pradip Mandal, Karmadhyaksha, Panchayat Samiti, Baruipur.
8. Mr. Yousuf Ali Molla, Pradhan, Hallikpur Gram Panchayat.
9. Mr. S. Sardar, Pradhan,
10. Mr. R.K.Verma, Power Grid Dev. Corpn. Ltd.
11. Mr. A. Paul -do-
12. Mr. Rukesh Kumar Singh, -do-
13. Mr. D. Dasgupta, M/s. A.C.Pakshi (Agent, P.G.C.L)
14. Mr. S. Pakshi, -do-
15. Mr. Jagai Sarda, Saha Savapati Baruipur Panchayat S.D.L&L.R.O, Baruipur

Mr. Jagai Sarda, Saha Savapati Baruipur Panchayat S.D.L&L.R.O, Baruipur started discussion regarding excavation of earth on vested agricultural land. He explained the hindrances of allowing excavation of earth on agri-land as per law. D.L&L.R.O, Baruipur and C/C, Brick field, S.D.L&L.R.O also explained and advocated from agri-vested land. Savapati, P.S. Baruipur proposed to excavate earth due to excavation of earth might be utilised for pisciculture by deploying the local rural youth. She also urged to declare those plots of land as non-agri land by the L.R. Authority. Savapati, P.S. Baruipur stated that in the case of part raiyati land alongwith vested land Co-operative Society may be formed and those raiyats and local unemployed youth might be included in the said society for pisciculture. A.D.M and D.L&L.R.O, South 24-Parganas vehemently expressed his views in the meeting that no agri-vested lot/part plot of land should be allowed for excavation of earth in favour of Power Grid Development Corpn. Ltd. or any other organisation. He expressed further that excavation of earth may be done from the canal maintaining its alignment properly as well as with the approval of concerned Authority. Then the session of

65

2/2

acquisition of land had been arised in the meeting by Panchayet functionaries. A.D.M and D.L&L.R.O emphasised that it is a long drawn process but such excavation of earth by P.G.C.L is needed at the earliest conveniences. F.G.C.L official advocated A.D.M and D.L&L.R.O. A.D.M and D.L&L.R.O proposed to purchase raiyati land by P.G.C.L which was advocated by Panchayet functionaries also. He also stated that conversion of each plots of land would be looked into.

After long discussion in the meeting it has been finally decided unanimously that the L.R Authority and local Panchayet functionaries should have no objection if the F.G.C.L Authority purchase the plots of land from different raiyats and start excavation of earth observing the following conditions.

1. P.G.C.L can be allowed to open only three sites for excavation of earth.
2. Raiyats of his own accord may apply for such conversion of land to D.L&L.R.O, Baraipur for pisciculture.
3. Application for such conversion of land in individual cases may be disposed of on priority basis abiding by the Govt. rules.
4. Excavation of earth by P.G.C.L would have to be done as per Govt. rules.

The aforesaid conditions (i.e. 2 to 4) would also be applied in the case of W.L.S.E.B. In the case of condition No. 1 W.L.S.E.B could be allowed to open two sites only.

At last, A.D.M and D.L&L.R.O, South 24-Parganas announced the end of the meeting with thanks to everybody present there.

sd/- Jawaid Akhtar
Additional District Magistrate
District Land & Land Reform Office,
South 24 Parganas
Baraipur

Mem. No. 11/
C 24/2002
Forwarded to:-

1. Mr./Mrs.
Information.



Sub-Divisional Land & Land Ref. Officer
Baraipur, South 24-Parganas.

1/21.11.04.

SOUTH GARIA NO.-1 GRAM PANCHAYET

VILL. + P.O. - SOUTH GARIA
P.S. - BARUIPUR • DIST. - SOUTH 24 PARGANAS.

Ref. No. SGP-1/69/35/04

Date 01/01/05

The Site Incharge,
Power Grid Corporation of India Ltd,
Subbas Gram/ Sub Station,
P.O. Vill. South Garia,
South 24 Parganas.

Dear Sir,

Sub:- Soil cutting & filling

Your attention is drawn to the guide line in respect of the above matter as was framed in the meeting held in the office of the S.D.L.R.O.

It is reported that without obtaining the formal approval from the authority concerned you are cutting soil from the Agricultural land for feeding the sub-station Area. The guide line as referred to above is not being followed.

You are therefore requested to stop the work and act strictly on the framed guide line.

Thanking you,

yours faithfully,

- cc1) The Sarbajit
Baruipur Panchayat Smith,
- 2) The B.D.P. Baruipur
- 3) The B.L. D.L.R.O. Baruipur,
- 4) The S.D.L.R.O. Baruipur.

S. Sarda
Pradhan 01/01/05

South Garia No.-1 Gram Panchayat



Ref. No. E/CL/SG/Soil Filling /24/ 05

Date : 04.01.2005

To
The Commissioner General,
Land & Land Reforms Deptt.,
Writers' Building, 1st Floor,
B.B.D. Bag, Kolkata-700001.

Kind Attn : Shri S.K. Chakraborty, IAS.

Dear Sir,

**Sub : Construction of 400 kV Sub-station at Subhasgram, Kolkata –
Allotment of land for excavation of borrowed earth for carrying
out the filling work.**

We would like to bring your kind notice that we are constructing a 400/220 kV Sub-station at Subhasgram in the vicinity of Kolkata at a total project cost of about Rs.100 crores. On completion, this project shall help improvement of the power situation in the state of West Bengal and especially Kolkata.

After extensive survey, keeping in view the technical requirements a site has been identified at Subhasgram – Champahati Station Road. This being a low lying area, about 1.5 meter of filling is required, in order to maintain ground level of Sub-station above HFL. The 400 KV Subhashgram substation is scheduled for commissioning by Nov., 2005 and thus the filling work was programmed to be completed by November 2004. For this purpose about 15 acres of land is essentially required for excavation and supplying borrowed earth. In this connection, a request was made for allotment of Govt. vested land over four months back, and orders for allotment of of this land were issued in the month of Nov '04. Later, due to reasons not known to us the earlier orders were cancelled. This has resulted in causing a delay in the completion of the filling work with consequential delay in the commissioning of the substation. We were advised at the district level to move fresh request for allotment of private land after obtaining 'No Objection Certificate' from the concerned authority. Mr. Barua, Joint Secretary, submitted an initial case for about four (4) Bighas of land to B.L.R.O. Barua, who has further advised us to route the case through the Joint Secretary, Barua.

पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड
(भारत सरकार वन अधिनियम)
POWER GRID CORPORATION OF INDIA LIMITED
(A Government of India Enterprise)



Telephone : 2359 6019, 2359 6026, 2337 4059 Fax : 2337 3281, E-mail : crskol@vsol.net, Gram: "NATGRID"
PLT - 498, Sector - III, Salt Lake City, Kolkata - 700 106

[2]

We would like to point out that this project is of National importance and such delays in the administrative process delay the entire project, since no activity can be carried out before the leveling is complete. We therefore solicit your co-operation and help in the matter.

A note of advice from your good offices for expediting the process and making it free from administrative delays could be enough in helping timely execution of the project. It may be not be out of place to point out that any delay would result in loss of working season and in the process delay the completion by atleast one (01) year if the rains set in before the completion of filling and leveling works.

Wishing you a happy New Year.

Thanking you.

Spencer
4/10/05
E.A. [Signature] General
Land [Signature] Deptt.
G. [Signature] of [Signature] [Signature]

Commissioner General
Land & Land Reform Deptt
Govt. of West Bengal


Yours truly

[Signature]
(V Mittal)

General Manager(I/C-ER)
Camp Kolkata

(Amme)

**POWER GRID CORPORATION OF INDIA
LIMITED**
(A Government of India Enterprise)



Telephone : 2359 6019, 23342692, Fax : 2337 3281, E-mail : ertskol@vsnl.net, Gram : "NATGRID"
FE - 494, Sector - III, Salt Lake City, Kolkata : 700 106

REF. NO. E/CL/SG/L&T/F-J TL/

DATE : 28.08.06

The Block Development Officer,
Haroa, North 24 Pargonas,
West Bengal.

**Sub: Obstruction of local villagers in construction of 400
KV Jeerat-Subhashgram Transmission Line.**

Dear Sir,
We are constructing the subject 400KV D/C transmission line under the Tala Hydro Electric project, Bhutan. On completion this line shall inter-alia help in providing cheaper power to the state of West Bengal.

During the course of construction between our tower location no. 33/1 and 34/0 falling in village -Boalghata,PO-Chouhata under police station - Haroa, some villagers who claim to belong to Boalghata Darus Shariah Siddiquia Khariji Madrasah are creating obstruction and not allowing the work to proceed for the last few months.

These persons have no locus standing in the matter, as neither the towers of our line are falling in their fields nor our line is passing through/over their houses or even the Madrasah. Moreover we like to draw your attention that for the following points:

SL. Description


Date Remarks

1 Gazette Notification published in Dec.2001 Nil
respect of above transmission
line.

2 Preliminary Survey for the line and subsequent fixation of its route on topographical map No Madrasah in the area except Mosque

3 Ground Survey, marking of towers & peg marking at Anchor points. Same as above.

POWER GRID CORPORATION OF INDIA
LIMITED
(A Government of India Enterprise)



FE - 494, Sector - III, Salt Lake City, Kolkata : 700 106
Telephone : 2359 6019, 23342692, Fax : 2337 3281, E-mail : ercskol@vsol.net, Gram: "NATGRID"

- | | | | |
|----|---|----------|---|
| 4 | TL work started. | 2004 | Nil |
| 5 | Foundation of tower loc. No. 33/1 & 34/0 completed. | 2005 | Objection was not raised by anyone. |
| 6 | Erection of tower(special type) completed on above locations. | 2005 | Objection was not raised by anyone |
| 7 | Stringing work started on above locations. | Feb.2006 | Obstructed by Madrasah authority. |
| 8. | Present status of subject cited transmission line as on date. | | Completed except the span length 800 mtrs. only in between tower location no. 33/0 to 34/0 and in the position of charging. |

In view of above it is requested that necessary order under Sec-16 of Indian Telegraph Act 1885 read with Sec-164 of Electricity Act 2003 may kindly be issued so that the work can be completed without any further delay.

It may not be out of place to mention that this project being linked to Tala HEP, Bhutan is of international importance and any further delay in execution of this project shall hamper the interest of the State as well as the Country.

We therefore solicit your help in the matter.

Thanking you,

Yours truly,

Manager (T)



Secretary

Minister in Charge
Power & Non-conventional Energy Sources and

Labour Departments

Government of West Bengal

Tel. Office - 2248 0706/1301 / 2244 55

Res: 2436 7727

Fax - 2243 8114/2244 1041

e-mail - wbpde@vsnl.net

No MIC-P/800

Sept 20, 2006

To,
The District Magistrate,
North-24 Parganas,
Barasat.

Sir,

I am enclosing an application from the General Manager (Project) to the Hon'ble Minister, for your kind perusal.

Besides the Project Authorities, I had also spoken to the BDO, Haroa requesting for his intervention to solve the problem. I understand, he would be sending you a report on the matter.

As stated by PGCIL, hardly 3 days work at site can close the project

You may kindly like to have the matter looked into so that the project is completed at the earliest

Thanking you

Yours truly

CCF

Soumendra Nath Banerjee (BSC) Sr. Secy

For the District Magistrate,
Barasat

CCF (P) Barasat

Government of West Bengal
Office of the District Magistrate
North 24-Parganas
Barasat


Memo No. 1808 /Con(G)

Date: 25th September, 2006

To
Block Development Officer,
Haroa Dev. Block.

Ref: His office memo no. 1183 dated 19.09.2006.

With reference to his status report received at this end, he is requested to look into the matter and take necessary steps so that the stringing work between location no. 33/0 and 34/0 is completed in a short period.



Addl. District Magistrate(G)
North 24-Parganas, Barasat

Memo No. 1808/1(2) /Con(G)

Date: 25th Sept., 2006

Copy forwarded to :-

1. Officer-in-Charge, Haroa P.S for information and necessary action.
2. General Manager(Proj), Power Grid Corporation of India Ltd, J-1-15, Block-EP, Sector-V, Salt Lake, Kolkata-91.


Addl. District Magistrate(G)
North 24-Parganas. Barasat

SH. AHAL PAUL

URGENT

Government of West Bengal
Office of the District Magistrate
North 24-Parganas
Barasat.

Memo.No. 2021 / Con(G).

Dated : 3rd November, 2006.

From : Addl. District Magistrate(G),
North 24-Parganas,
Barasat.

To : Superintendent of Police,
North 24-Parganas,
Barasat.


Sub : LILO of Farakka-Jeerat 400 KV line at Subhashgram.

Enclosed please find a copy of letter no.FR-II/KOL/SSGM-TL/203 dated 02.11.2006 since received from Shri S. Sen, General Manager(Proj.), Power Grid Corporation of India Limited in which it has been assured that the above mentioned project can be completed within seven days, if adequate security arrangement is done.

You are requested to kindly make necessary arrangement to provide adequate security arrangement for enabling them to complete the project within their time-frame given in the letter under reference.

A report on action at the earliest in this regard may kindly be intimated to this end.


Encl : As stated.


Addl. District Magistrate(G)
North 24-Parganas
Barasat.

Memo.No. 2021/1(4)/Con(G). Dated : 3rd Nov., 2006.

Copy with copy of enclosure forwarded to :-

- 1) SDO Basirhat for information and necessary action
- 2) BDO Haroa for information and necessary action
- 3) Shri S.Sen, General Manager(Proj.), Power Grid Corporation of India for information. This has reference to his memo no. ER-II/KOL/SSGM-TL/203 dated 02.11.2006.


Addl. District Magistrate(G)
North 24-Parganas
Barasat.



POWER GRID CORPORATION OF INDIA
LIMITED
(A Government of India Enterprise)



Telephone : 2359 6019, 23342692, Fax : 2337 3281, E-mail : crtskol@vsnl.net, Gram : "NATGRID"
FE - 494, Sector - III, Salt Lake City, Kolkata : 700 106

REF. NO. E/CL/SG/L&T/F-J (TL)/

DATE : 07.11.06

To,
The Sub-Divisional Officer,
Basirhat, Dist.- 24 Pargonas (N),
West Bengal.

Sub. LILO of Farakka-Jeerat 400 KV Transmission Line at Subhashgram.

- Ref. 1. Our letter ref. no. ER-II/KOL/SSGM-TL/203 dtd. 02.11.06
2. Letter of ADM (G), 24Pgs(N) no. 2021/Con (G) dtd. 3.11.06 addressed to Superintendent of Police, 24 Pgs (N) and copy marked to our GM (Projects).

Dear Madam,

This is in reference to the above mentioned letters and subsequent discussion had with you in your office at Basirhat on 4.11.06 we are hereby giving our revised schedule for the stringing work in between the tower location no. 33/0 to 34/0 passing through the Village-Boalghata, Mouza & PO - Chouhata of the above mentioned transmission line.

Sl.	Date	Activity	No. of days
1	14.11.06	Shifting of T&P from Duttapukur store to site and Insulator hoisting.	1
2	15.11.06	Tightening of nuts and bolts of tower, paying out of pilot wire and earth wire.	1
3	16.11.06- 19.11.06	Conductor paying out	4
4	20.11.06	Fitting of accessories and anti-climbing device	1
Total			7 days

While submitting this programme, we seek your kind intervention and support for ensuring uninterrupted work for these days with adequate security arrangement. Thanking you and looking forward for your favourable consideration,

Your faithfully,

(Signature)

CC: SDOP, Basirhat - For your information and kind consideration.

Government of West Bengal
Office of the District Magistrate
North 24-Parganas
Barasat.

Memo.No. 2056/Con(G).

Dated 8th November, 2006


From : Addl. District Magistrate(G),
North 24-Parganas,
Barasat.

To : General Manager (Proj.),
Power Grid Corporation of India Limited,
B.J-1-15, Block-EP,
Sector-V, Bidhannagar,
Salt lake.

Sub : L.I.O of Farakka-Jeerat 400KV line at Subhashgram

With reference to his letter no.ER-II/KOL/SSGM-TI/1203 dated 02.11.2006 this is to inform that the matter has been taken up with Supdt. of Police, North 24-Parganas requesting to provide security arrangement for early completion of the project vide this office memo.no.2021/Con(G) dated 3rd November, 2006 with a copy to him. He is requested to lay the highlighted string first so that the dispute is resolved.


This is for his information and taking necessary action



Addl. District Magistrate(G)
North 24-Parganas
Barasat

Memo.No. 2056/1/Con(G).

Dated 8th Nov., 06.

Copy forwarded to CA to DM, North 24-Parganas for DM's kind information.


Addl. District Magistrate(G)
North 24-Parganas
Barasat

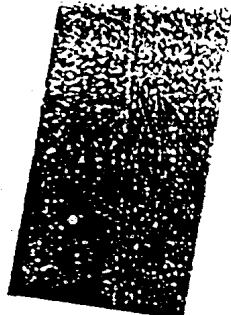

S.O. 91

**POWER GRID CORPORATION OF INDIA LTD.
EASTERN REGIONAL LOAD DESPATCH CENTRE
14, GOLF CLUB ROAD, TOLLYGUNGE KOLKATA - 700 033**

Fax Message No _____ Date 12.04.2006 10.00 AM
From : General Manager ERLDC, POWERGRID, Kolkata
To : 1) Chief Engineer, C. D. WBSEB, Howrah
2) Genl. Manager, ESTPP, NTPC, Farakka
Sub : **Dismantling of 400 kV 50 MVAR 3 phase
Shunt Reactor at Jeerat for Farakka - Jeerat Ckt. II
- Operation of the circuit without the Reactor**

This is in reference to the request from ERTS II POWERGRID to examine the feasibility of operating the Farakka - Jeerat line II without Line Reactor in the event of dismantling of the Reactor for shifting it to Subhashgram. The Farakka - Jeerat line is around 240 Kms with a 50 MVAR Line Reactor at Jeerat. In the proposed shifting of the Reactor, the aforesaid line has to be operated without the Line Reactor till the LILO at Subhashgram and installation of the Reactor at Subhashgram is completed.

Under the circumstances, ERLDC proposes the following switching operation at Jeerat for taking Farakka - Jeerat Ckt II into service without the reactor for issuance of clearance to POWERGRID for safety of Line Reactor at Subhashgram :-


Sequence of Switching


- 1) Switch off the Farakka - Jeerat line II
- 2) Switch over all the other lines to Bus I except the 50 MVAR Line Reactor. Keep the Bus Reactor at Bus II
- 3) Switch off the Bus Reactor at Bus II
- 4) Switch on the 50 MVAR Line Reactor at Subhashgram
- 5) Switch on the Farakka - Jeerat line II
- 6) Switch on the bus Reactor at Bus II

Regards

S. K. Banerjee
General Manager

FARAKKA & JEERAT 400KV VOLTAGES- 25/3/06

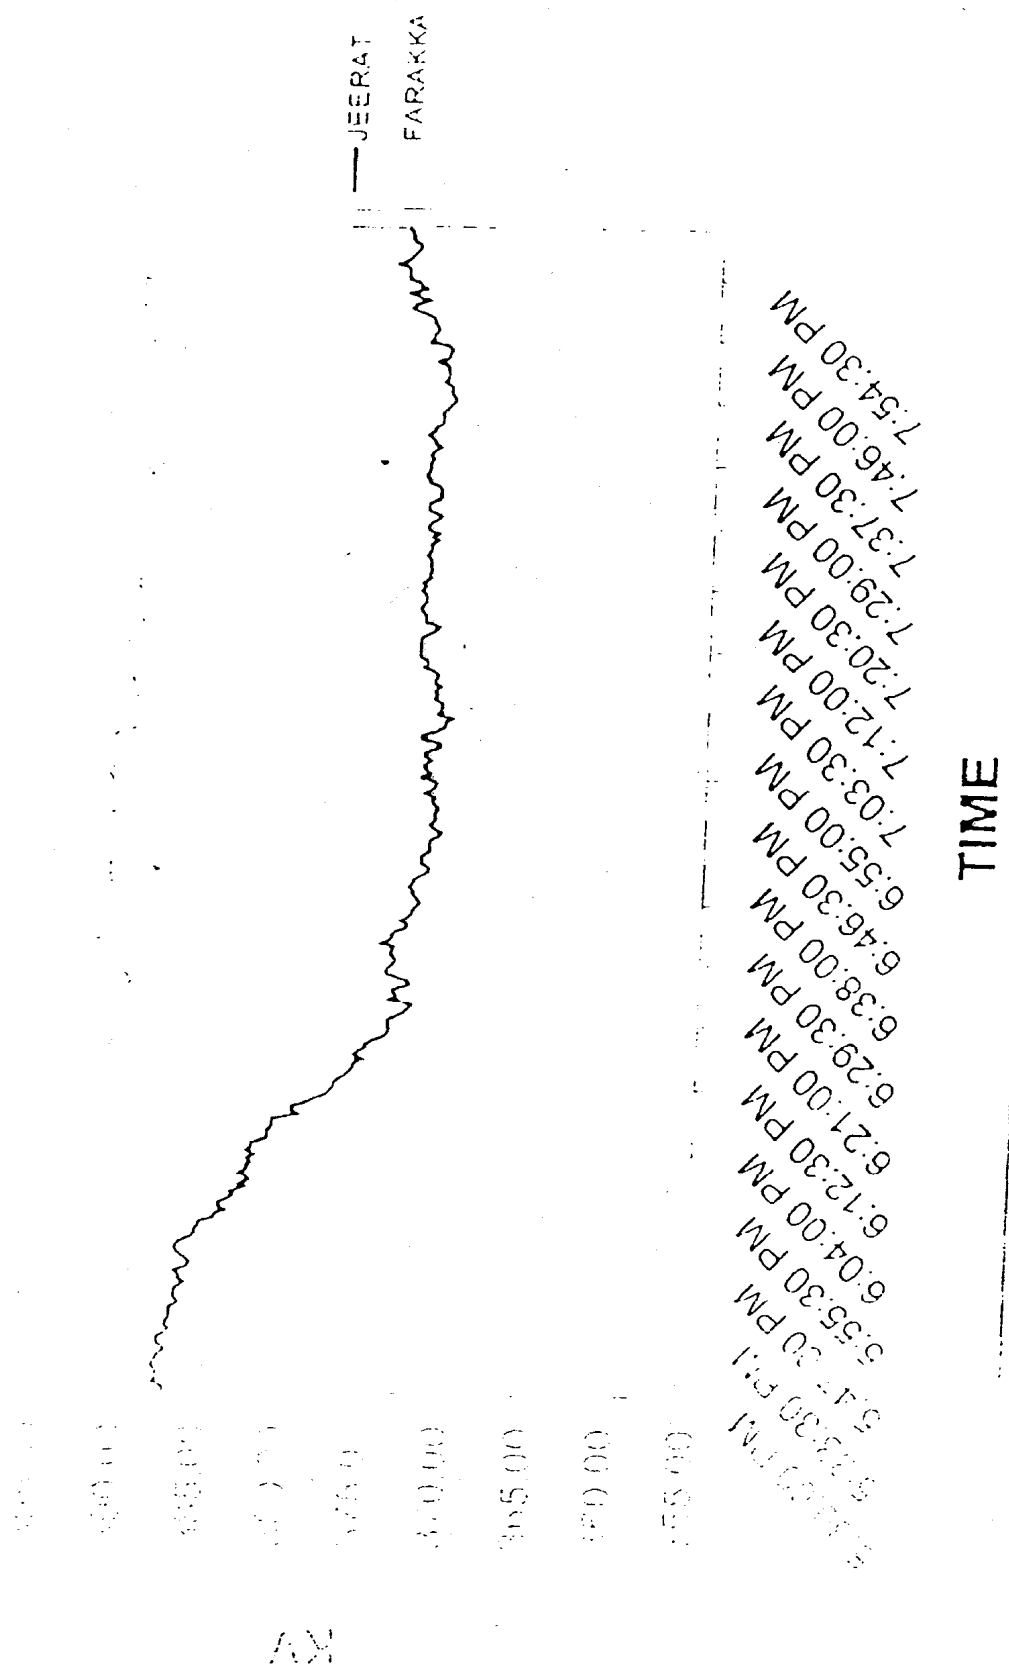



Save Energy for Benefit of Self and Nation

पावर गिड कारपोरेशन ऑफ इंडिया लिमिटेड

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)

400/220 KV सव स्टेशन, सुभाषग्राम, चम्पहाटी रोड, दक्षिण गंगा, 24 पारगना (दक्षिण)
400/200 KV Substation, Subhasgram, Champahati Road, South Ganga, 24 Parganas (South)
Telephone : 2359-6026, Fax : 2337-3281, Gram : NATGRID

Ref. No. E/SGR/112/370

Date : 23.05.2006

To
The Chief Engineer (Central Planning),
W.B. State Electricity Board,
Bidyut Bhawan, 9th Floor,
Salt Lake City,
Kolkata - 700 091

Sub : Dismantling of 400 KV 50 MVAR 3 Ph. Shunt Reactor at
Jeerat for Farakka-Jeerat Ckt.II.

Sir,

Kindly refer telecon the undersigned had with your goodself on 23.05.2006. You would appreciate that the shutdown of the reactor is immediately necessary for dismantling and transportation to POWERGRID S'Gram substation before the monsoon sets in. We had proposed shutdown of the reactor on 19th & 20th May'06 for the said purpose. But the same could not be availed due to non-readiness of WBSEB in respect of the control and relay circuit isolation.

Your goodself is requested to kindly expedite the steps that are necessary for extending shutdown of the reactor so that the dismantling work can be taken up at the earliest.

Thanking you,

Yours faithfully,

(S.K. Roy,
Dy.General Manager,
S'Gram Project

CC : Ch.Engr.(Trans.Maint.), WBSEB, Bidyut Bhawan, S/Lake, Kol-91.
(Sh. N.S. Chakraborty)

CC : GM (N/C-ER-II), POWERGRID, Kolkata. }
CC : GM - ERLDC, POWERGRID, Kolkata. } for more information
CC : GM (PROJ.), POWERGRID, ER-II, Kolkata. } please
CC : GM (OS), POWERGRID, ER-II, Kolkata }

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड
POWER GRID CORPORATION OF INDIA LIMITED
A Government of India Enterprise

J-1-15, Block EP, Sector-V, Salt Lake, Kolkata-700 091, Tel. 23572815, 23572817 Fax 23572818, 23572819
ज-1-15, ब्लॉक ई.पी., सेक्टर-5, साल्ट लेक, कोलकाता-700 091, दूरभाष 23572815, फैक्स 23572818, 23572819

पूर्वी क्षेत्र पारेषण प्रणाली
Eastern Region Transmission System

Ref.No: ER-II/Kol/ED/1787/

Dated: 17.10.2006

To,

Shri M.K. Ray,
Member (Commercial)
West Bengal State Electricity Board,
Bidyut Bhawan, Salt Lake
Kolkata-700 091

Sub: Shifting of 50 MVAR shunt reactor from Jeerat to Subhashgram

Dear Sir,

This has reference to decisions taken in the meeting of Standing Committee on Power System Planning for Eastern Region dated: 22.06.06 at Mirik. Accordingly, the offices of Chief Engineer(Trans. Maint.) and Chief Engineer(CP&ED), WBSEB were approached by our engineers for shifting of the 50 MVAR shunt reactor from Jeerat to Subhashgram.

It was then indicated that the shifting could be possible only after the Diwali. Now that festivals will all be over by 25th of this month, we are asking our erection agency to take necessary steps for shifting the equipment.

Necessary instructions may kindly be issued from your good office to the concerned sites/departments for extending all help and support for the purpose.

Thanking you,

D. Chowdhury
General Manager

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड

(एक सरकारी कंपनी)

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)

400/220 KV का एक नया उपग्राम चम्पाहाटी रोड, साउथ गारिया, 24 परगणा (मध्य) वि. 74 प.स. 74 प.स. 74 प.स. 03218 211421/211404, फोन 03218 273132, जि. "NATGRID"

400/220 KV Substation Subhasgram, Champahati Road, South Garia, 24 Pgs (S) Dist. Telephone 03218 211421/211404, Fax 03218-273132, Gram "NATGRID"

पूर्वी क्षेत्रीय पारेषण प्रणालि
Eastern Region Transmission System

Ref No. ER-II/SGR/208/685

Date : 21.11.2006

To
The Project Manager,
M/s. Crompton Greaves Ltd.,
S'Gram S/Stn. Site,
Subhasgram
Kind Attn: Mr. R.A. Felbin.

Sub : Regarding 50 MVAR Shunt Reactor.

Sir,

WBSEB authorities have agreed for the shifting of 50 MVAR BHEE make shunt reactor of presently Farakka-Jeerat Ckt.II at Jeerat. Shut down for the said circuit has already been planned from 26.11.2006 to 28.11.2006 (both days inclusive)

You are requested to make all necessary arrangements for the dismantling of bushings and other accessories of the reactor during the shutdown period positively by 25th Nov.,2006 so that the dismantling work can be started immediately after the shutdown and issuance of work permit from WBSEB to POWERGRID.

The matter may please be treated as **IMPORTANT & URGENT**.

Thanking you,

Yours faithfully,

(S.K. Roy)

Dy. General Manager
S'Gram Project

CC: AGM (S'Gram), Salt Lake, Kolkata

CC: EM (OPER) POWERGRID, Kolkata

CC: GM (PROJ), ER II, POWERGRID, Kolkata