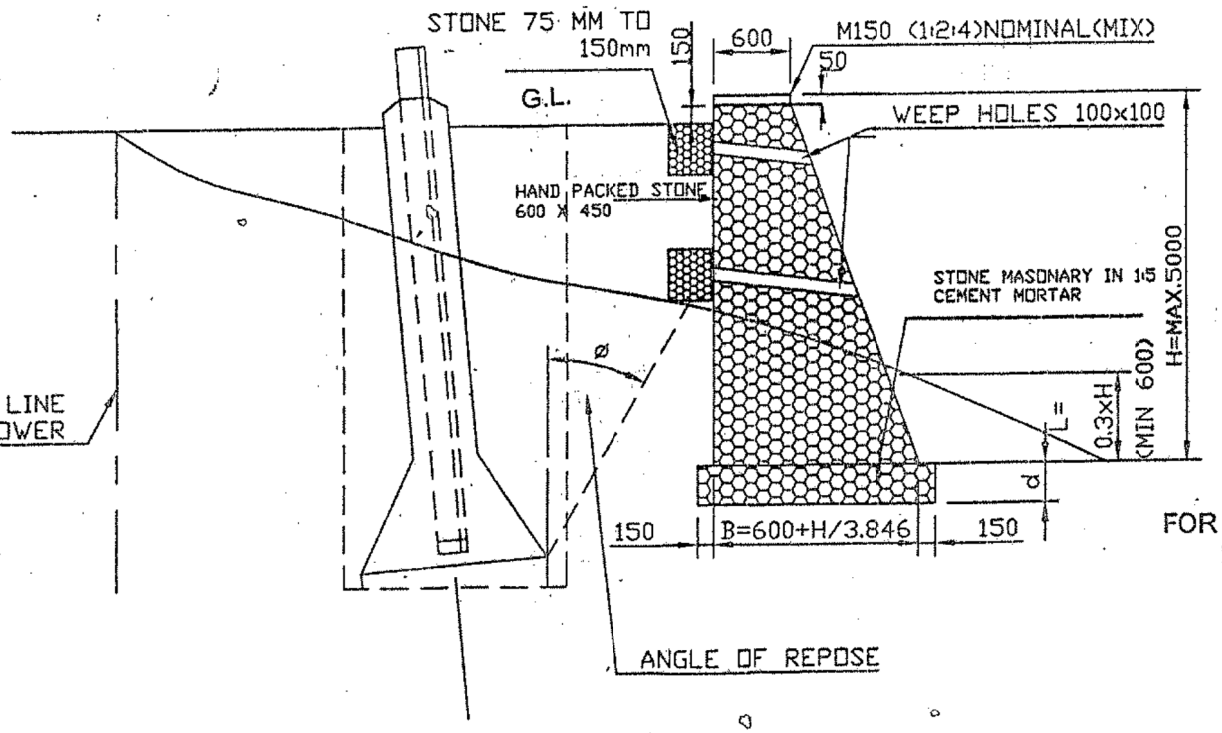


FOR H ≥ 1000, d = 230
H < 1000, d = 150

NOTES

1 : ALL DIM. ARE IN MM UNLESS OTHERWISE SPECIFIED.
2 : WEEP HOLES SHOULD BE OF SIZE 100mm x 100mm OR 150mm x 150mm INCASE OF LARGE SIZE REVETMENT.
3 : WEEP HOLES SHOULD BE 2.5Mt C-C APART HORIZONTAL
4 : CENTER OF TOP MOST WEEP HOLES TO BE NOT LESS THAN 300 mm BELOW TOP
5 : THE MIN. DEPTH OF REVETMENT WALL BELOW G.L. WILL BE 600mm
6 : DIM. 'B' ARE VALID ONLY FOR 'H' NOT EXCEEDING 5.00 METER
7 : SIZE OF STONE FOR MASONARY WORK. 300 x 150 x 150 & BELOW
8 : THE MASONRY WORK SHOULD BE CARRIED OUT IN 1:5 CEMENT MORTAR
9 : SIZE OF STONE PACKING AT WEEP HOLE 75 mm TO 150mm

FOR BID PURPOSE ONLY

	POWER GRID CORP. OF INDIA LTD.
PROJECT	KV TRANSMISSION SYSTEM
TITLE	PROTECTION OF TOWER FOOTING (DOWN/UP HILL)
DRG. NO.	TL/STD/PTF / REV. 0

POWER GRID CORPORATION OF INDIA LTD.
UNIQUE STRUCTURES & TOWERS LTD. BHILWARA (C.G.)