

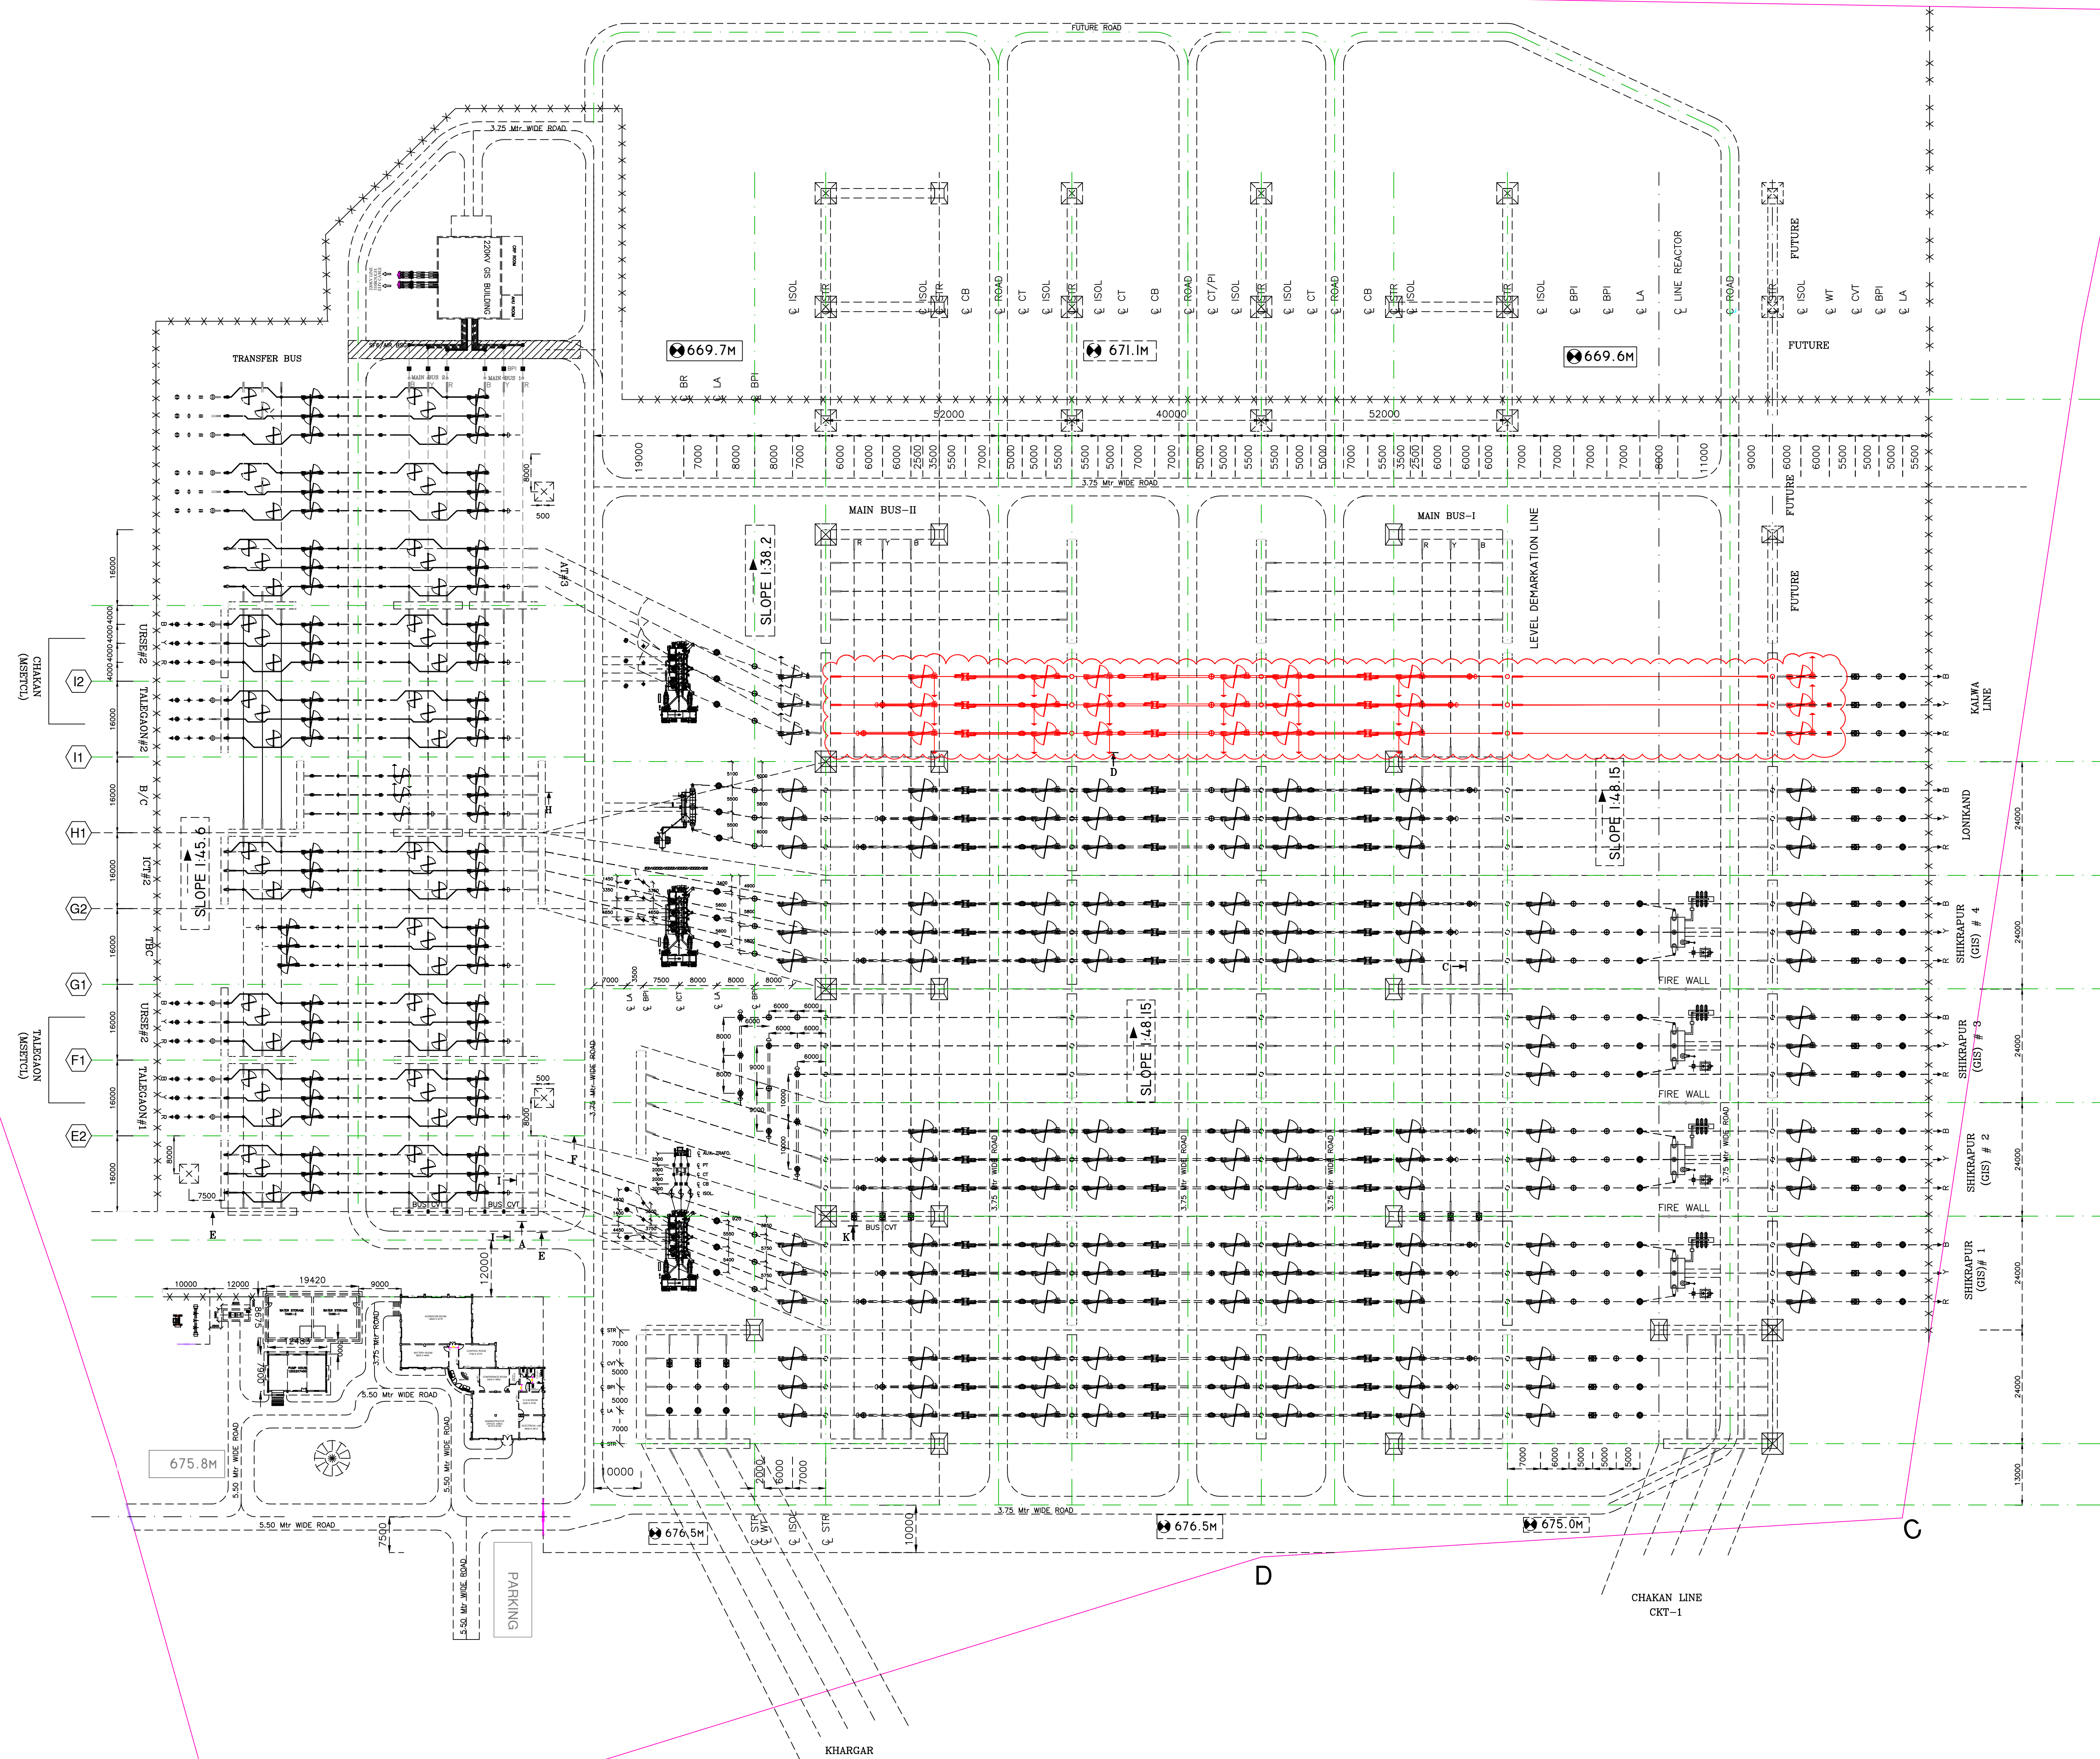




LEGEND

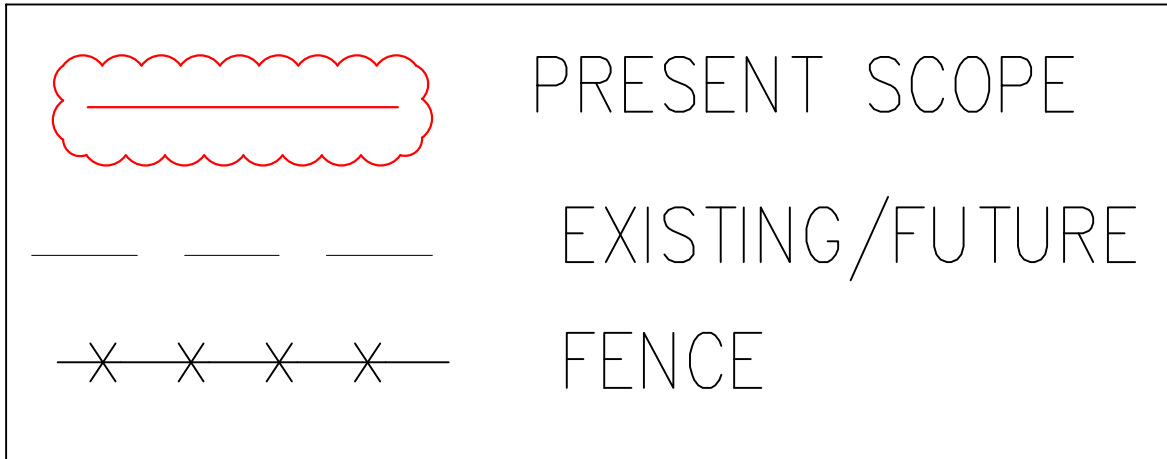


NOTE-

1. LINE SIDE EQUIPMENT CONNECTIONS FROM 400KV OVERHEAD VIKROLI LINE NEED TO BE CHANGED WITH CLAMP/CONNECTORS SUITABLE FOR TWIN HTLS CONDUCTOR, UNDER PRESENT SCOPE OF WORK.

FOR TENDER PURPOSE ONLY

POWER GRID CORPORATION
OF INDIA LIMITED
(A Government of India Enterprise)



PROJECT: NETWORK EXPANSION SCHEME FOR DRAWAL OF POWER AT SOUTH KALAMB S/S:PART C (POWERGRID BAY UPGRADATION)

SUBSTATION:
400/220kV PUNE SUBSTATION

TITLE : GENERAL ARRANGEMENT DRAWING (UPGRADATION OF 400KV BAYS)
PUNE (TALEGAON) S/S

DRAWN	DATE	SCALE	DRAWING NO.	REV.
		N.T.S.	C/ENGG/WR/PUNE/400KV BAY/UPGRAD/GA/01	0