


Sketch Drawing of River Protection Work at Kankai River Near Tower Location-43 of 400KV D/C Kishanganj-Saharsa TL

Annexure-C

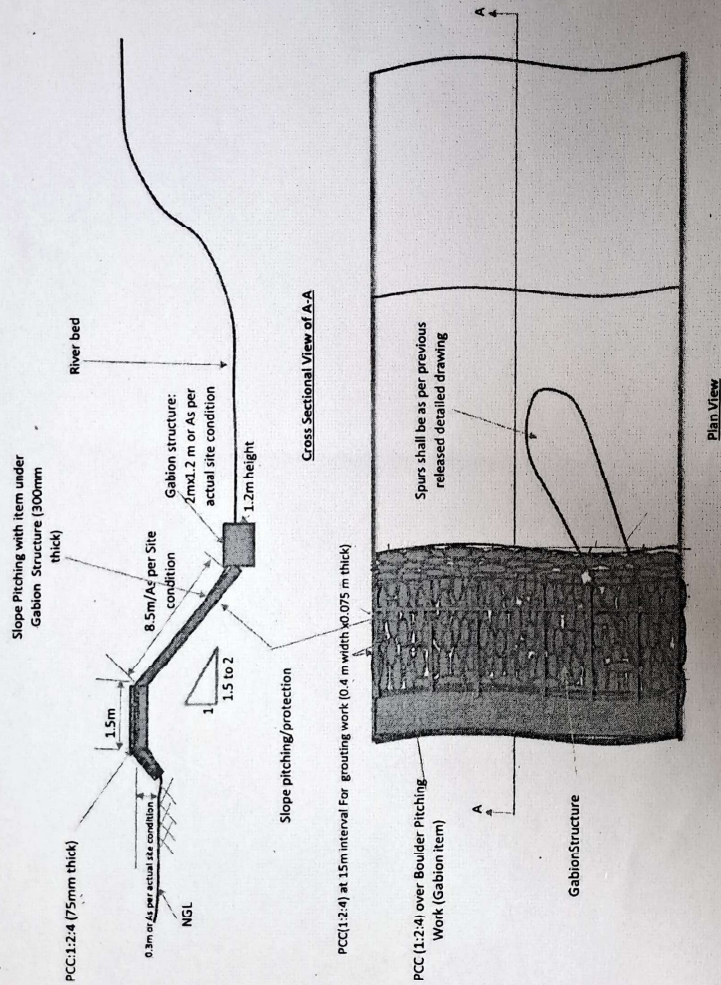

Note: (i) Bank protection with item under gabion structure shall have Slope 1: 1.5 to 2 (i.e 1 vertical and 1.5 to 2 horizontal), (ii) Sketch drawing is not to scale (iii) Revised Sketch drawing is prepared based on site data & constraints. (iv) Spurs shall be as per previous released drawing and as per site conditions.

Plan View

मानवेंद्र कुमार/ANVENDRA KUMAR
अ. प्रमुख (ऑफिस) / Asst. General Manager (Engineering)
पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड
POWER GRID CORPORATION OF INDIA LIMITED
एन.डी. कैंपस, बारा-8, बारा, पटना-800 009, 009
Barrack Camp, Bara-8, Bara, Patna-800009

29/05/2023

29-05-23