



SPEED POST

Ref No: NESH/ PESM/ RTI/ 1117/ 01

Date: 02.04.2024

To,

Purnananda Borah

Moharicamp, P.O. Ukamati, P.S. Gogamukh,
Dist. Dhemaji, Assam-787056

&

Pallab Kumar Borah

Naharbari Kachari, P.O. Ukamati, P.S. Gogamukh,
Dist. Dhemaji, Assam-787056
+91-8011476489 / +91-8822446323

विषय : आपके आरटीआई आवेदन दिनांक 12.03.2024 जो की सीपीआईओ कार्यालय में दिनांक 18.03.2024 को प्राप्त हुआ, उस का उत्तर ।

Sub : Reply to your RTI Application dated 12.03.2024 received at CPIO's office on 18.03.2024.

Sir,

- 1.0 This has reference to your RTI application dated 12.03.2024 under RTI Act, 2005 received at CPIO's office on 18.03.2024.
- 2.0 As per inputs received from concerned department/site, the information pertaining to your RTI Application is given below:

Sl. No.	Query	Information
(b)	To which place the current will be transmitted from Gerukamukh Hydro-electric Power Project? Kindly provide a copy of route map of current transmission.	The copy of route map is enclosed as Annexure-I .
(d)	How many towers will be erected in the state of Assam? Give the details of the towers to be erected in hills area, wet land and agricultural land.	The tower schedule of 400kV Lower Subansiri-Biswanath Chariali Line-I & II is available at site. The applicant can visit POWERGRID North Lakhimpur TLC office at <i>H/o-Tulan Chandra Lahan, Near Little Flower English school, Nalkata, Bowalguri, PO Bagalijan, North Lakhimpur, Assam-787031</i> on any working day between 10:00am to 4:00pm with prior intimation to: <i>Sh. B Boro, DGM (TLC), North Lakhimpur (Mobile no.: 9485107650).</i> Documents identified by the applicant during inspection at our North Lakhimpur TLC office shall be made available on payment of charges through demand draft or banker's cheque payable to "Power Grid Corporation of India



		Limited, Shillong”, being document charge as per RTI Act, 2005.
(e)	What will be the grade of the towers? Kindly furnish the specification of towers with diagram.	The information sought is intellectual property is nature and the same is exempted from disclosure under section 8(1)(d) of RTI Act, 2005.
(f)	How much land has been acquired in the State of Assam for setting the power transmission line? Give details.	As per Electricity Act, 2003 & Indian Telegraph Act, 1885, there is no provision for acquisition of land for construction of transmission line.
(g)	Whether compensation has been paid for the acquired land? If yes, give details of compensation paid.	
(h)	Whether NOC has been obtained from Ministry of Environment and Forest, Govt. of India and concerned State Government, National Highway Authority of India, Ministry of Railway Department, Geological Survey of India and Department of Land and Revenue, Assam. If yes, please provide the copies NOC.	<p>The various NOC obtained for 400kV Lower Subansiri-Biswanath Chariali Line-I & II is available at site.</p> <p>The applicant can visit POWERGRID North Lakhimpur TLC office at <i>H/o-Tulan Chandra Lahan, Near Little Flower English school, Nalkata, Bowalguri, PO Bagalijan, North Lakhimpur, Assam-787031</i> on any working day between 10:00am to 4:00pm with prior intimation to:</p> <p><i>Sh. B Boro, DGM (TLC), North Lakhimpur (Mobile no.: 9485107650).</i></p> <p>Documents identified by the applicant during inspection at our North Lakhimpur TLC office shall be made available on payment of charges through demand draft or banker’s cheque payable to “Power Grid Corporation of India Limited, Shillong”, being document charge as per RTI Act, 2005.</p>
(i)	What are the safety measures taken to avoid untoward incident due to breakage of cable and tower?	
(j)	What measures have been taken to avoid electric affect upon the human and wild live on transmitting the high voltage transmission current?	The query does not fall under the ambit of ‘information’ as defined in section 2(f) of RTI Act, 2005.



पावरग्रिड
POWERGRID

पावर ग्रिड कॉरपोरेशन ऑफ इंडिया लिमिटेड
(भारत सरकार का उद्यम)
POWER GRID CORPORATION OF INDIA LIMITED
(A Government of India Enterprise)

3.0 First Appeal, if any, against the reply of CPIO may be made to the first Appellate Authority within 30 days of the receipt of the reply of CPIO. Details of Appellate Authority of Power Grid Corporation of India Limited, NERTS, under RTI Act, 2005 is as below:

Sh. Upananda Kataki, ED (NERTS)
POWERGRID, Dongtieh, Lower Nongrah,
Lapalang, Shillong - 793006, Meghalaya.
0364-2536371, u.kataki@powergrid.in

आपको धन्यवाद,


भवदीय,


(A L SYNGKON)
GM & CPIO
0364-2536439,
nerts_rti@powergrid.in

PROJECT: 400 KV D/C (TWIN LAPWING) LOWER SUBANSIRI TO BISWANATH CHARIALI
TRANSMISSION LINE-I & LINE -II

OWNER : POWER GRID CORPORATION OF INDIA LTD. (A GOVT OF INDIA ENTERPRISE)

NAME OF EXECUTING AGENCIES : 1. KALPATARU POWER TRANSMISSION LIMITED (TW3B PACKAGE)
2. TRANSRAIL LIGHTING LIMITED (TW6B PACKAGE)

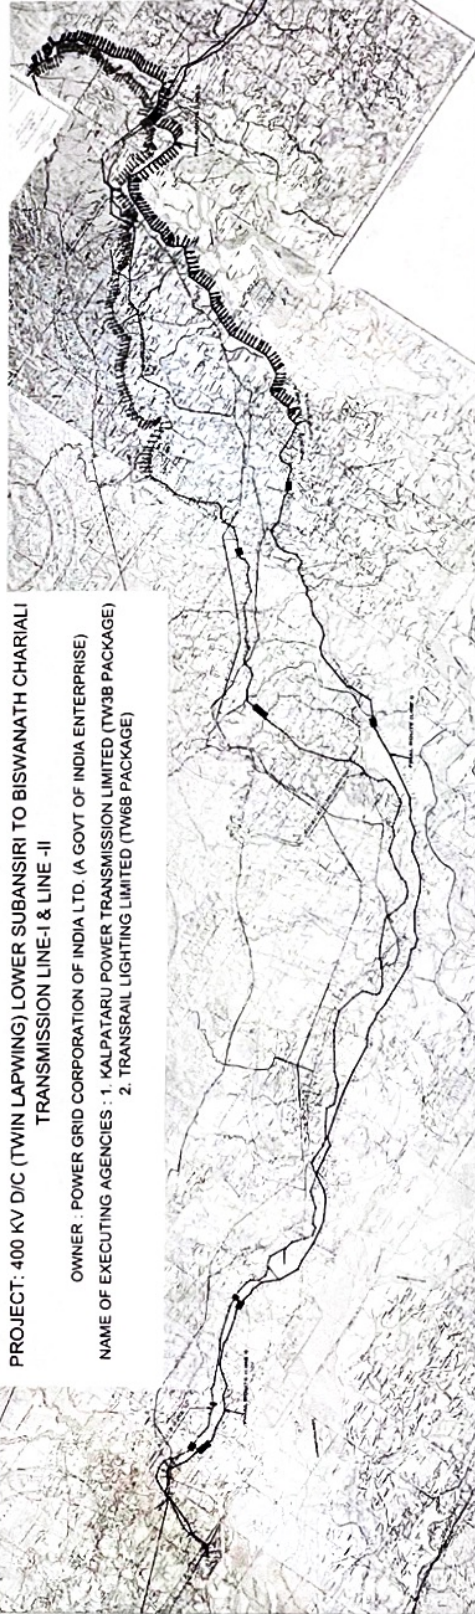

LINE DETAILS					
Sl. No	LINE NAME	TOTAL LINE LENGTH	LINE LENGTH UNDER RPTL SCOPE	LINE LENGTH UNDER TLL SCOPE	LINE LENGTH UNDER TLL SCOPE
1	LINE - I	179.36 KMS	58.61 KMS	120.75 KMS	120.75 KMS
2	LINE - II	185.81 KMS	57.72 KMS	128.09 KMS	128.09 KMS

LEGEND	
1	PROPOSED LINE
2	EXISTING LINE
3	EXISTING TOWER
4	EXISTING CROSSING
5	EXISTING ROAD
6	EXISTING RAILWAY
7	EXISTING WATER BODY
8	EXISTING POWER LINE
9	EXISTING TELEPHONE LINE
10	EXISTING FENCE
11	EXISTING BOUNDARY
12	EXISTING SETBACK
13	EXISTING OBSTACLE
14	EXISTING TOWER
15	EXISTING CROSSING
16	EXISTING ROAD
17	EXISTING RAILWAY
18	EXISTING WATER BODY
19	EXISTING POWER LINE
20	EXISTING TELEPHONE LINE
21	EXISTING FENCE
22	EXISTING BOUNDARY
23	EXISTING SETBACK
24	EXISTING OBSTACLE

