

प.क्षे.-II/ लोक सूचना/2023/00016/

दिनांक : 02/02/2023

सेवा में,
श्री पीनलकुमार दिलीपभाई पटेल
Koliwad-Kotha/via-Amalsad,
Taluka-Gandevi, Dist.-Navsari,
Pin – 396 310, Gujarat.
मोबाइल नं.- 99047 17576

विषय : सूचना का अधिकार अधिनियम 2005 के अंतर्गत मांगी गयी जानकारी के संबंध में ।


महोदय,

सूचना के अधिकार अधिनियम 2005 के तहत आपके द्वारा दिनांक 04/01/2023 को प्रेषित पत्र सं.- PGCIL/R/E/23/ 00016, पावरग्रिड क्षेत्रीय मुख्यालय में दिनांक 05/01/2023 को प्राप्त हुआ है। आवेदन पत्र में मांगी गयी जानकारी इस पत्र के साथ संलग्न प्रेषित है।

यदि आप केंद्रीय लोक सूचना अधिकारी के उत्तर से संतुष्ट न हों तो, CPIO के उत्तर की प्राप्ति के 30 दिनों के भीतर अपीलिय अधिकारी के सम्मुख अपील कर सकते हैं। आरटीआई अधिनियम, 2005 के तहत अपीलिय अधिकारी का नाम और पता निम्नानुसार है;

श्री कृष्ण कुमार टी. आर. (कार्यपालक निदेशक), अपीलीय अधिकारी,
पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड,
क्षेत्रीय मुख्यालय, पश्चिम क्षेत्र-2
प्लॉट नं.-54, रिया-रेवती रिसोर्ट के पास, समा-सावली रोड,
वडोदरा – 390 024 (गुजरात).

धन्यवाद सहित,

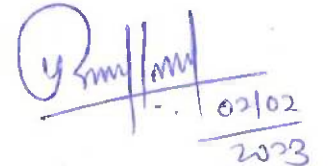

02/02
2023

(पंकज दलाल)

केन्द्रीय लोक सूचना अधिकारी
पश्चिम क्षेत्र – II, वडोदरा


संलग्न : यथोपारि

प्रतिलिपि: -

1. कार्यपालक निदेशक (प.क्षे.-II), वडोदरा – सादर सूचनार्थ
2. वरिष्ठ महाप्रबंधक (सतर्कता), प.क्षे.- II
3. मुख्य प्रबन्धक (LAW), प.क्षे.- II


This has reference to the RTI no. PGCIL/R/E/23/00016 by Shri Pinalkumar Dilipbhai Patel received on dated 05/01/2023 regarding details about 765kV Navsari (New) - Padghe & 400kV Navsari (New) - Magarwada T/L – pointwise concise reply is as follows;

आरटीआई अर्जी	आरटीआई का उत्तर
1. Detailed Map of High Transmission Line from North side to South side in Navsari District, Valsad District & Daman (U.T.) Area.	Detailed map is enclosed as Annex.-A
2. List of Objections raised in response to the Advertisement dated: 24/09/2022.	List of objections enclosed as Annex.-B
3. Details of:	Transmission lines work is in initial stage of construction. Detailed survey work is under progress. Information sought by the applicant is not readily available.
i) High Tension poles: with Survey No., Area Occupied & Village.	
ii) Row of Way corridor with Survey No., Village & Area Occupied	RoW is 67 Meter for 765kV & 46 Meter for 400kV T/L. As the transmission lines work is in initial stage of construction, rest information sought by the applicant is not readily available.
iii) Height of High Tension Pole.	81.14 Meter Approx. (Height shall be Varyig according to the types of Tower).
iv) Height of wires from Land Levels.	For 400kV T/L – 8.89 Meter from Ground Level For 765kV T/L – 18.15 Meter from Ground Level
v) Widht of Four Legs & High Tension Line.	21 Meter (May vary according to the Soil Strata).
vi) Widht of Civil Work required to construct High Tension pole.	36 Meter Approx. (May vary according to the types of Tower).
vii) Distance of Two High Tension poles.	350 to 400 Meter Approx. (May vary based on Survey)



Page 1 of 2

4. Copy of Tender Documents for Survey and Total Tower & Wire Line Installation work.	Tender Documents for Survey, Total Tower & Wire Line Installation work is available in public domain. You are advising to please visit the following link; https://apps.powergrid.in/pgciltenders/u/default.aspx
5. Work Orders Assigned for Survey and Total Tower & Wire Line Installation work.	The disclosure of this information is exempted under Section 8(1)(d), 8(1)(e) and 8(1)(j) of RTI Act.
6. Name, Designation, Office Address, E-Mail, Phone Number, Local Office of Power Grid Corporation of Navsari District.	Address of the office; House no.-5, Crystal Bungalow, Shiv Parbati Krupa Society, Navsari – 396 445, Gujarat.



02/02
2023
(पंकज दलाल)

केन्द्रीय लोक सूचना अधिकारी
पश्चिम क्षेत्र – II, वडोदरा

Page 2 of 2

Annex.- A

400kV T/L.

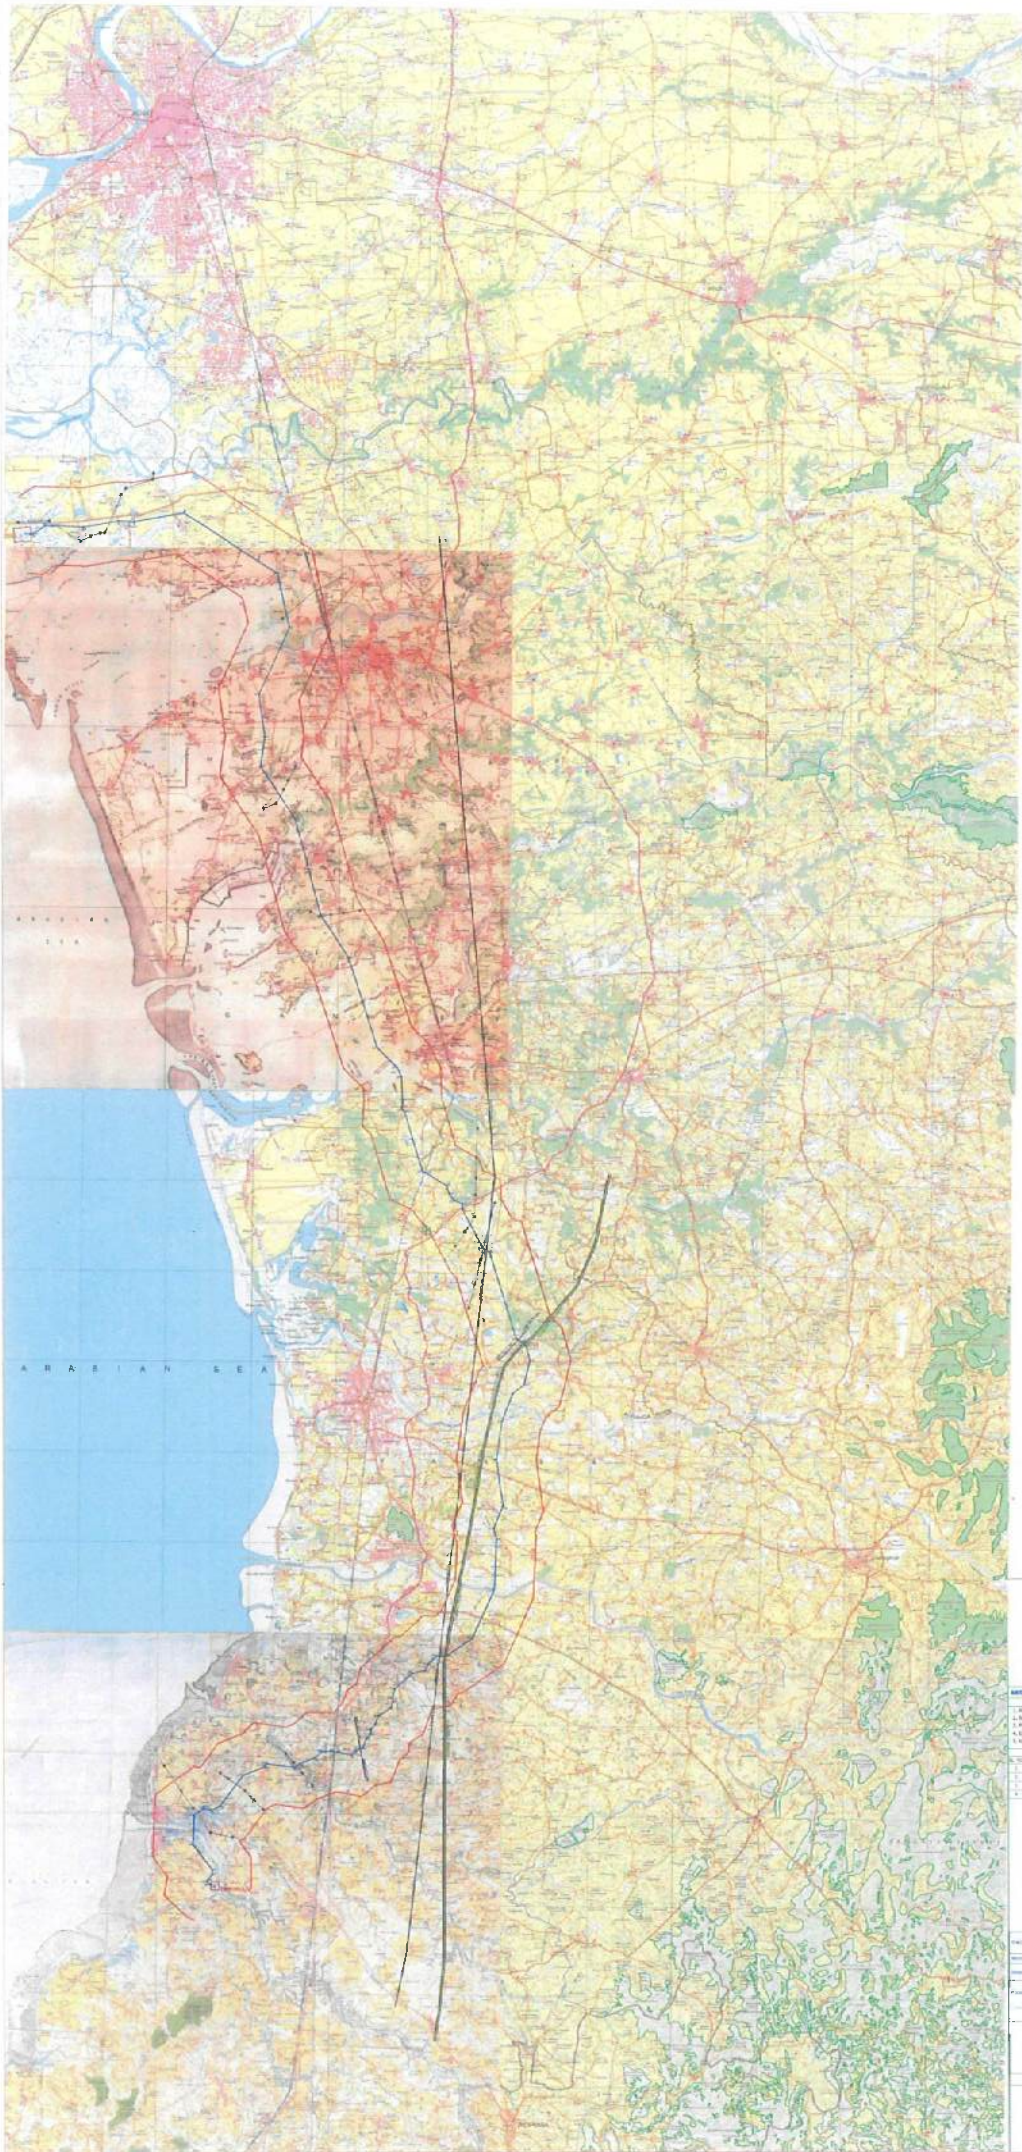

Scale: 1:50,000

North Arrow

Legend


Symbol	Description
—	Proposed 400 kV Transmission Line
—	Existing High Voltage Transmission Lines
—	Existing Low Voltage Transmission Lines
—	Proposed 220 kV Transmission Lines
—	Proposed 110 kV Transmission Lines
—	Proposed 33 kV Transmission Lines
—	Proposed 15 kV Transmission Lines
—	Proposed 6.6 kV Transmission Lines
—	Proposed 3.3 kV Transmission Lines
—	Proposed 1.1 kV Transmission Lines

Key Plan

Sheet 1 of 1

Power Grid Corporation of India Limited

465KV T/L

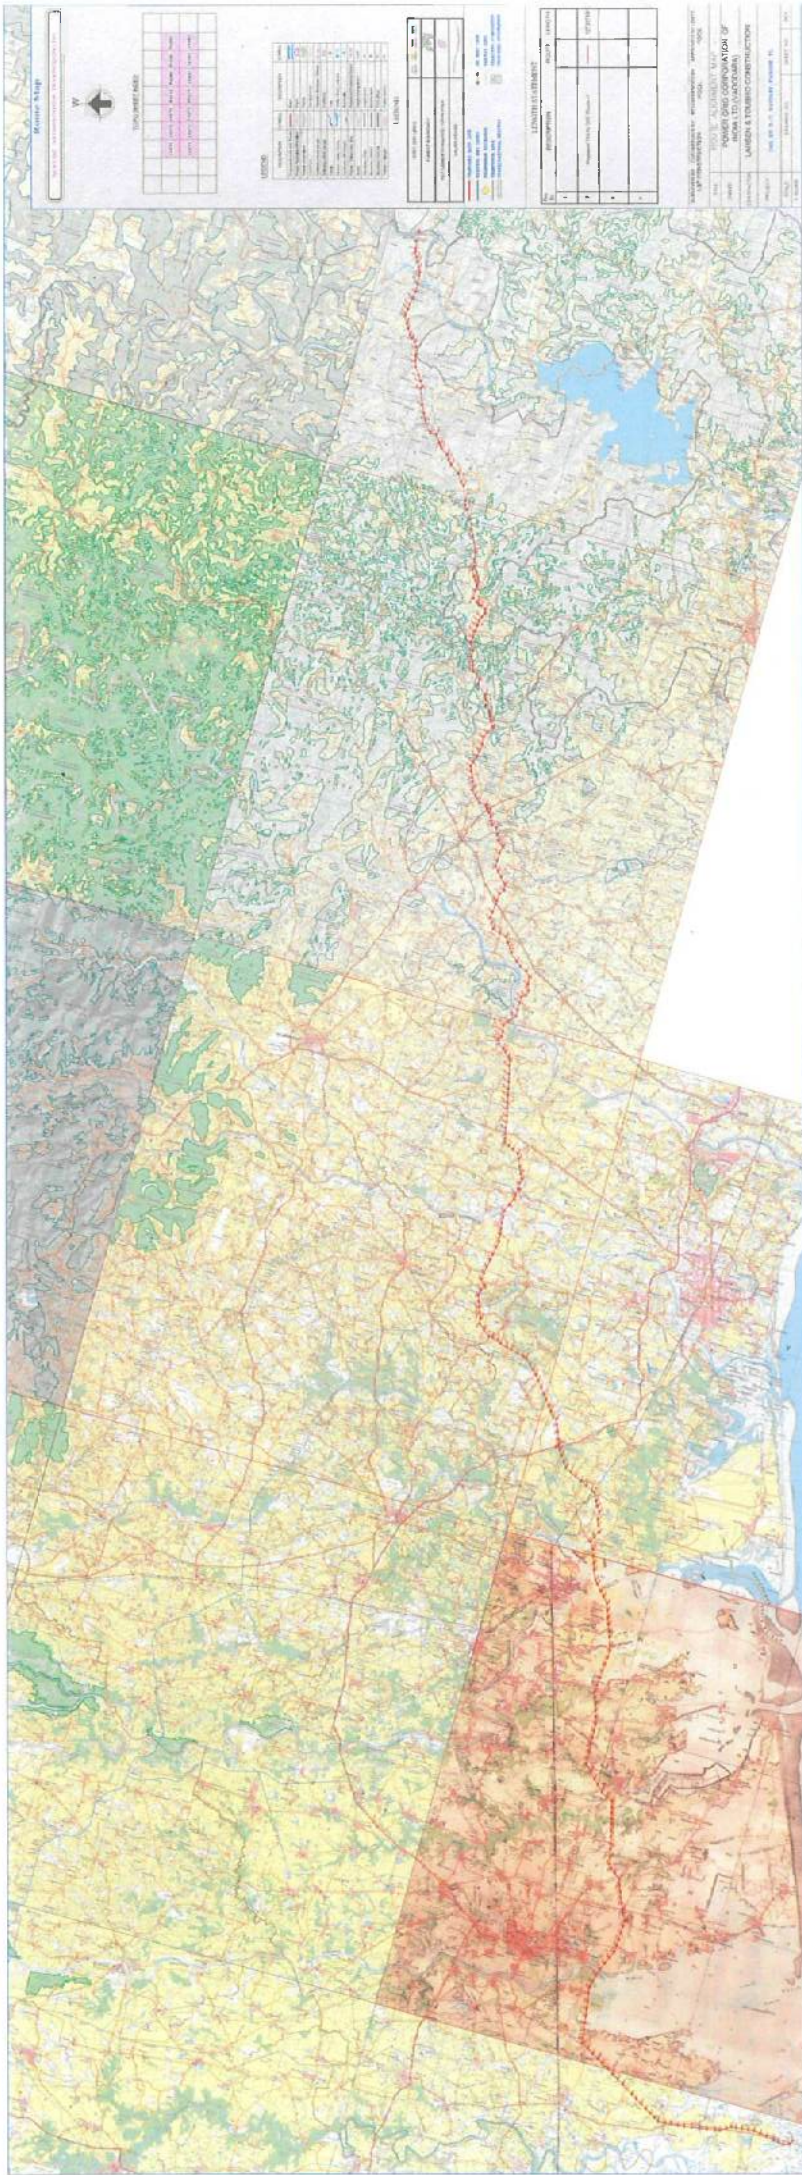

Annex.-B

Sl. No.	Name of the Person / Organization	Date of submission of objection letter
1	Mukeshbhai Lallubhai Patel	21/11/2022
2	Baghubhai B Patel, Rupeshbhai C Patel (Shri Valsad Vibhag Khedut Samaj)	21/11/2022
3	Udaybhai Shah	23/11/2022
4	Darshan Ranjitbhai Shah	23/11/2022
5	Mehta Tubes Ltd.	24/11/2022
6	Daxay B Ahir	7/11/2022
7	Co. estate (India) LLP, Ashay M Mehta	24/09/2022
8	Govindbhai Ballabhai Ahir etc.	22/11/2022