



WESTERN REGIONAL LOAD DESPATCH CENTRE

F-3, MIDC Area, Andheri (East) Marol, Mumbai - 400 093, CIN : U40105DL2009GOI188682
Phone (O) : 022-28202690, 28203885, 28203885, Fax : 022-28235434, 28202630 website: www://wrldc.com

WRLDC/GM/MIS/RTI/309/16/276

Date: 07.03.2016

TO

Shri Shripal Jain,
BD-7G, DDA Flats,
Munirka,
New Delhi-110067

Subject: Information sought under RTI Act, 2005.

Dear Sir,

This is with reference to your application no. nil, dated 22.01.2016 received at WRLDC from our Powergrid, Vadodara office on 16.02.2016 regarding the subject matter as follows-

Package A: Replacement of Pilot Strings having Glass insulators with composite long rod polymer insulators in 765 KV Indore-Vadodara line

Package B: Replacement & Packaging of Porcelain disc insulators with composite long rod polymer insulators in 400 KV D/C Pirana-Vadodara Line I & Pirana- Vadodara Line II.

The Reply of query pertaining to WRLDC (query No. 2) is as mentioned below-

Q2. What has been the average load flow and Power flow during 2014 & 2015?

R2. The lines mentioned in Package A & Package B were commissioned on following dates:


- i. 765 KV Indore-Vadodara line - Dt. 06.06.2015
- ii. 400 KV Pirana-Vadodara Line I - Dt. 31.05.2015
- iii. 400 KV Pirana-Vadodara Line II - Dt. 27.06.2015.

Average Load Flow of the following lines (SCADA Data) after commissioning date from June'15 to Dec'15 are as mentioned-

- i. 765 KV Indore-Vadodara – 795 MW (Load duration curve attached)
- ii. 400 KV Pirana-Vadodara Line-I – 264 MW (Load duration curve attached)
- iii. 400 KV Pirana-Vadodara Line-II – 268 MW (Load duration curve attached)

Hope this would clarify your query.

Thanking You.



(V K Shrivastava)
GM (GM& SO) & CPIO

Name and Designation of Central Public Information officer (CPIO): Sh. V. K. SHRIVASTAVA G.M (GM&SO) Ph. No 022-28314609 E-mail: vks@posoco.in, vks@powergridindia.com

Name and Designation of Appellate Authority: Sh. P. MUKHOPADHYAY, General Manager Ph.No. 022-28202691 E-mail: prithwish.pmukh@gmail.com


CC: 1. ED, WR-II, Vadodara
2. GM & AA, WRLDC, Mumbai
3. CPIO, Vadodara } : - for kind information please.

765 KV Indore-Vadodara Line Flow 6th June'15 to Dec'15

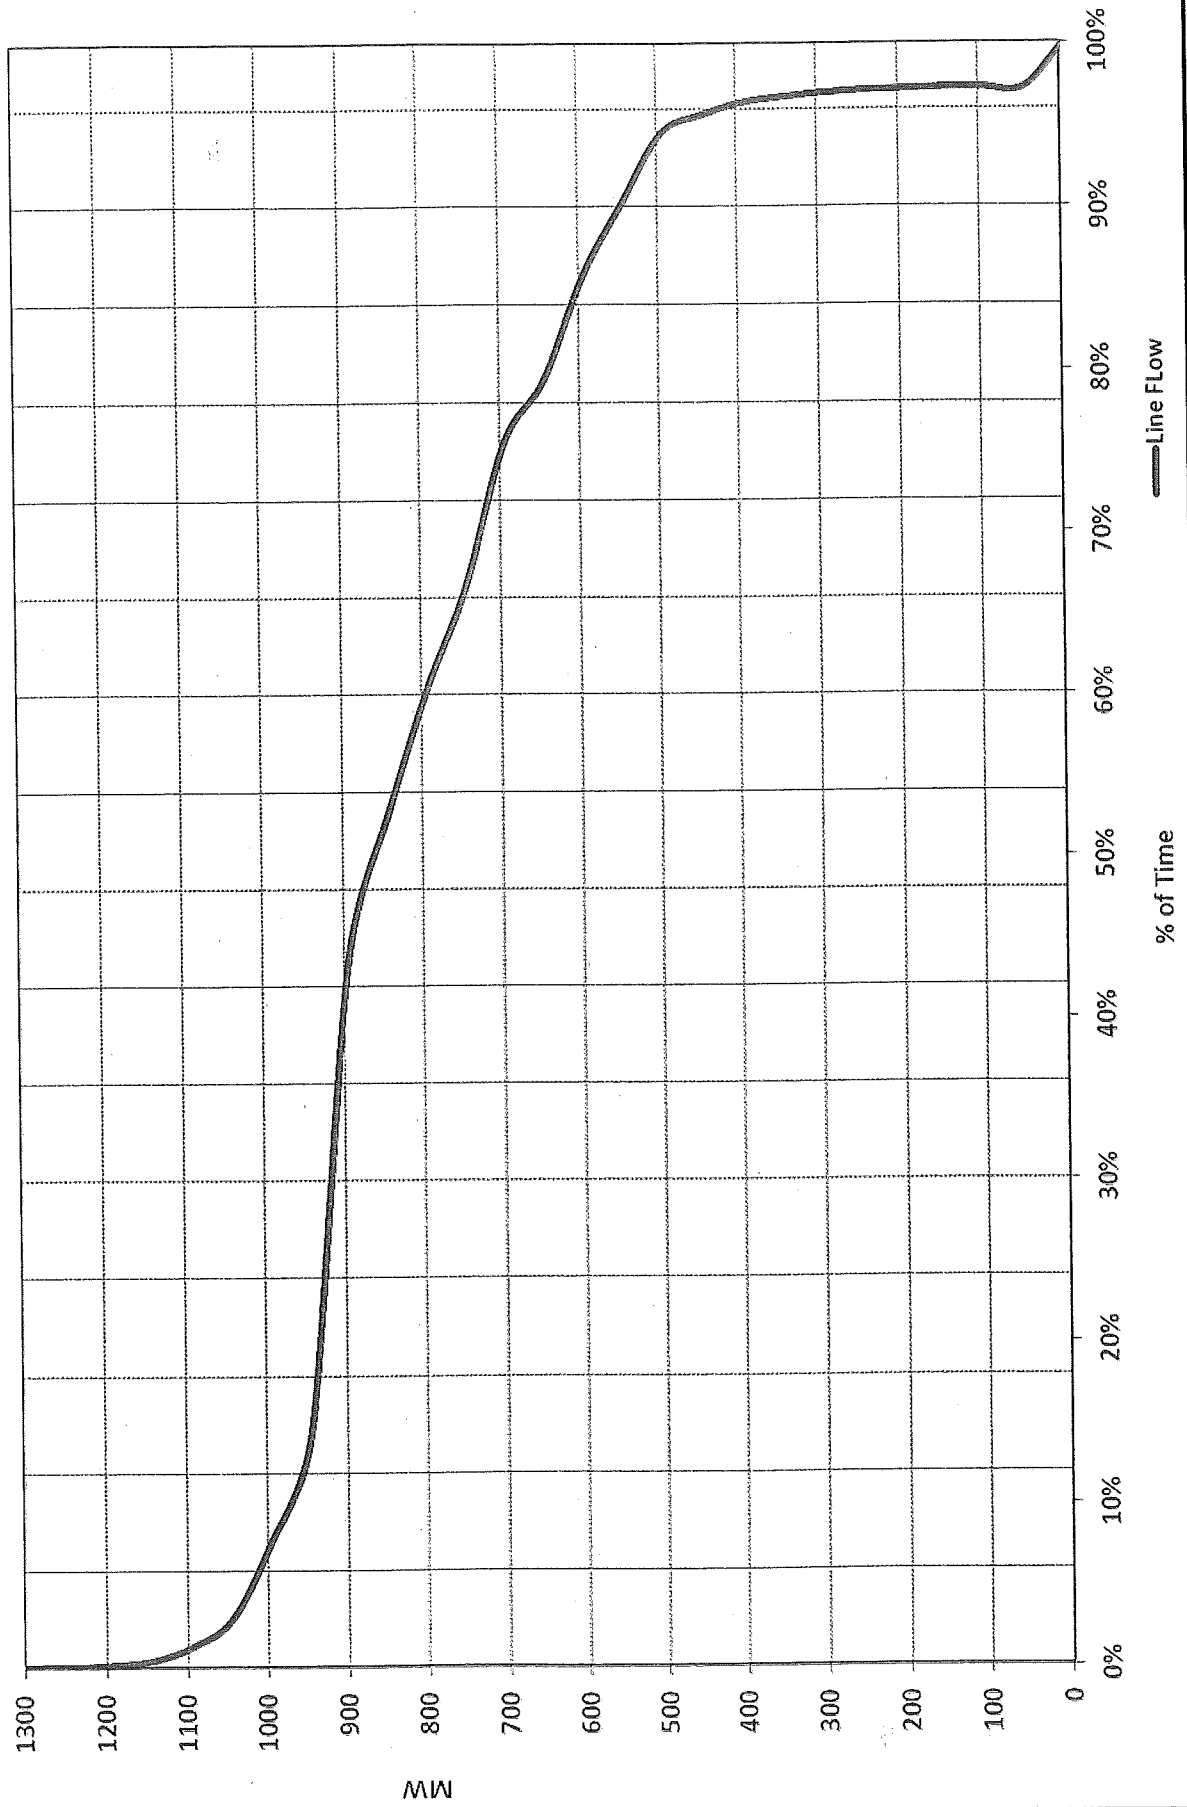



400 KV Vadodara-Pirana ckt-I Line Flow June'15 to Dec'15

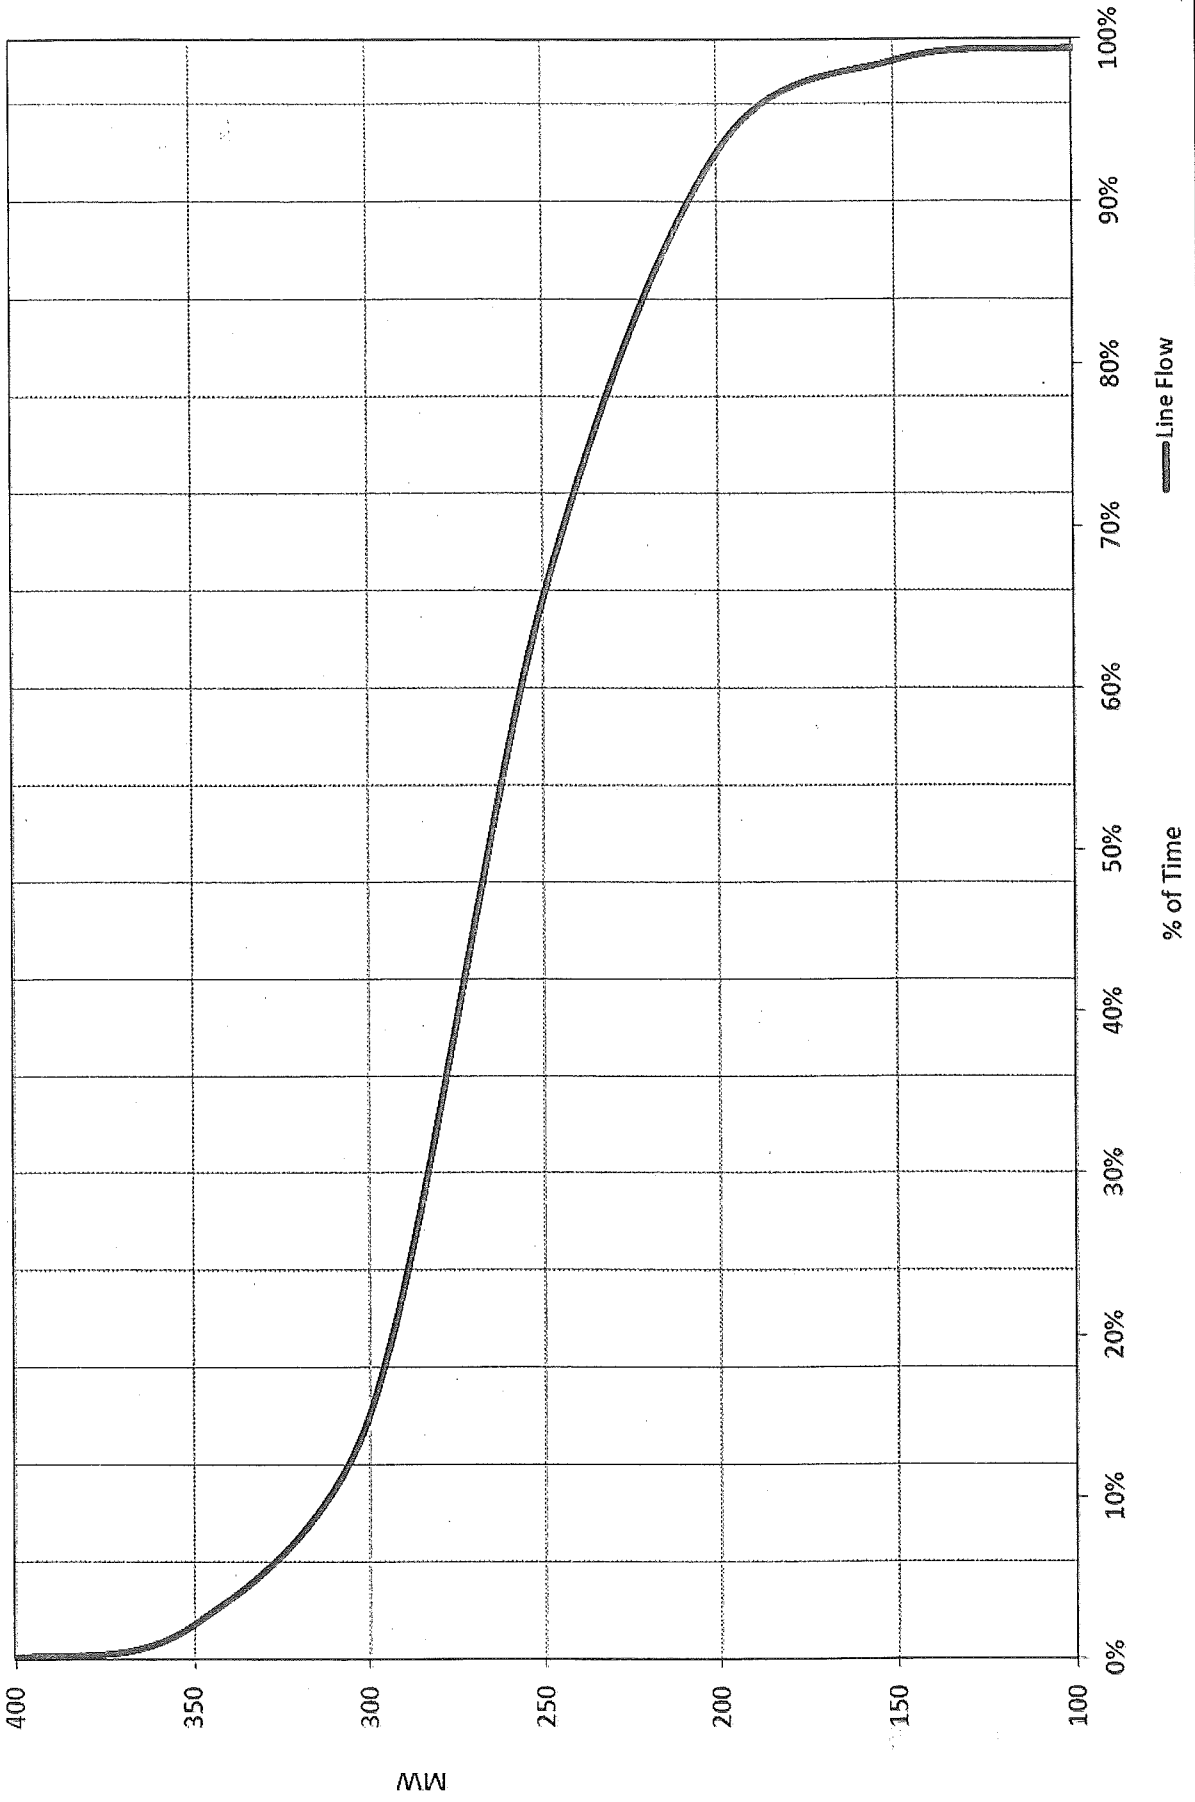

400 KV Vadodara-Pirana ckt-II Line Flow 27th June'15 to Dec'15

